


# CITY OF FORT WRIGHT KENTON COUNTY, KENTUCKY 115 KENNEDY PLAYGROUND SITE GRADING

39397

INDEX OF SHEETS		
NO.	DWG NAME	SHEET NAME
1	TTL	TITLE
2	NOTES	NOTES & LEGEND
3	DET1	CONSTRUCTION DETAILS 1
4	C01	EXISTING CONDITION & DEMO PLAN
5	C02	SITE & UTILITY PLAN
6	C03	GRADING AND EROSION PLAN
7	C04	STORM WATER POLLUTION PREVENTION PLAN



CITY OF FORT WRIGHT OFFICIALS
<b>MAYOR</b> DAVE HATTER
<b>CITY ADMINISTRATOR</b> JILL C. BAILEY
<b>CITY CLERK</b> KERRIE HOLLAND
<b>CITY COUNCIL MEMBERS</b>
SCOTT WALL
BERNIE WESSELS
MARGIE WITT
JUSTIN WEBER
JASON COLLINS
DONNA ROSS
<b>CITY ATTORNEY</b> JOHN S. BROOKING
<b>PUBLIC WORKS DIRECTOR</b> JEFF BETHELL

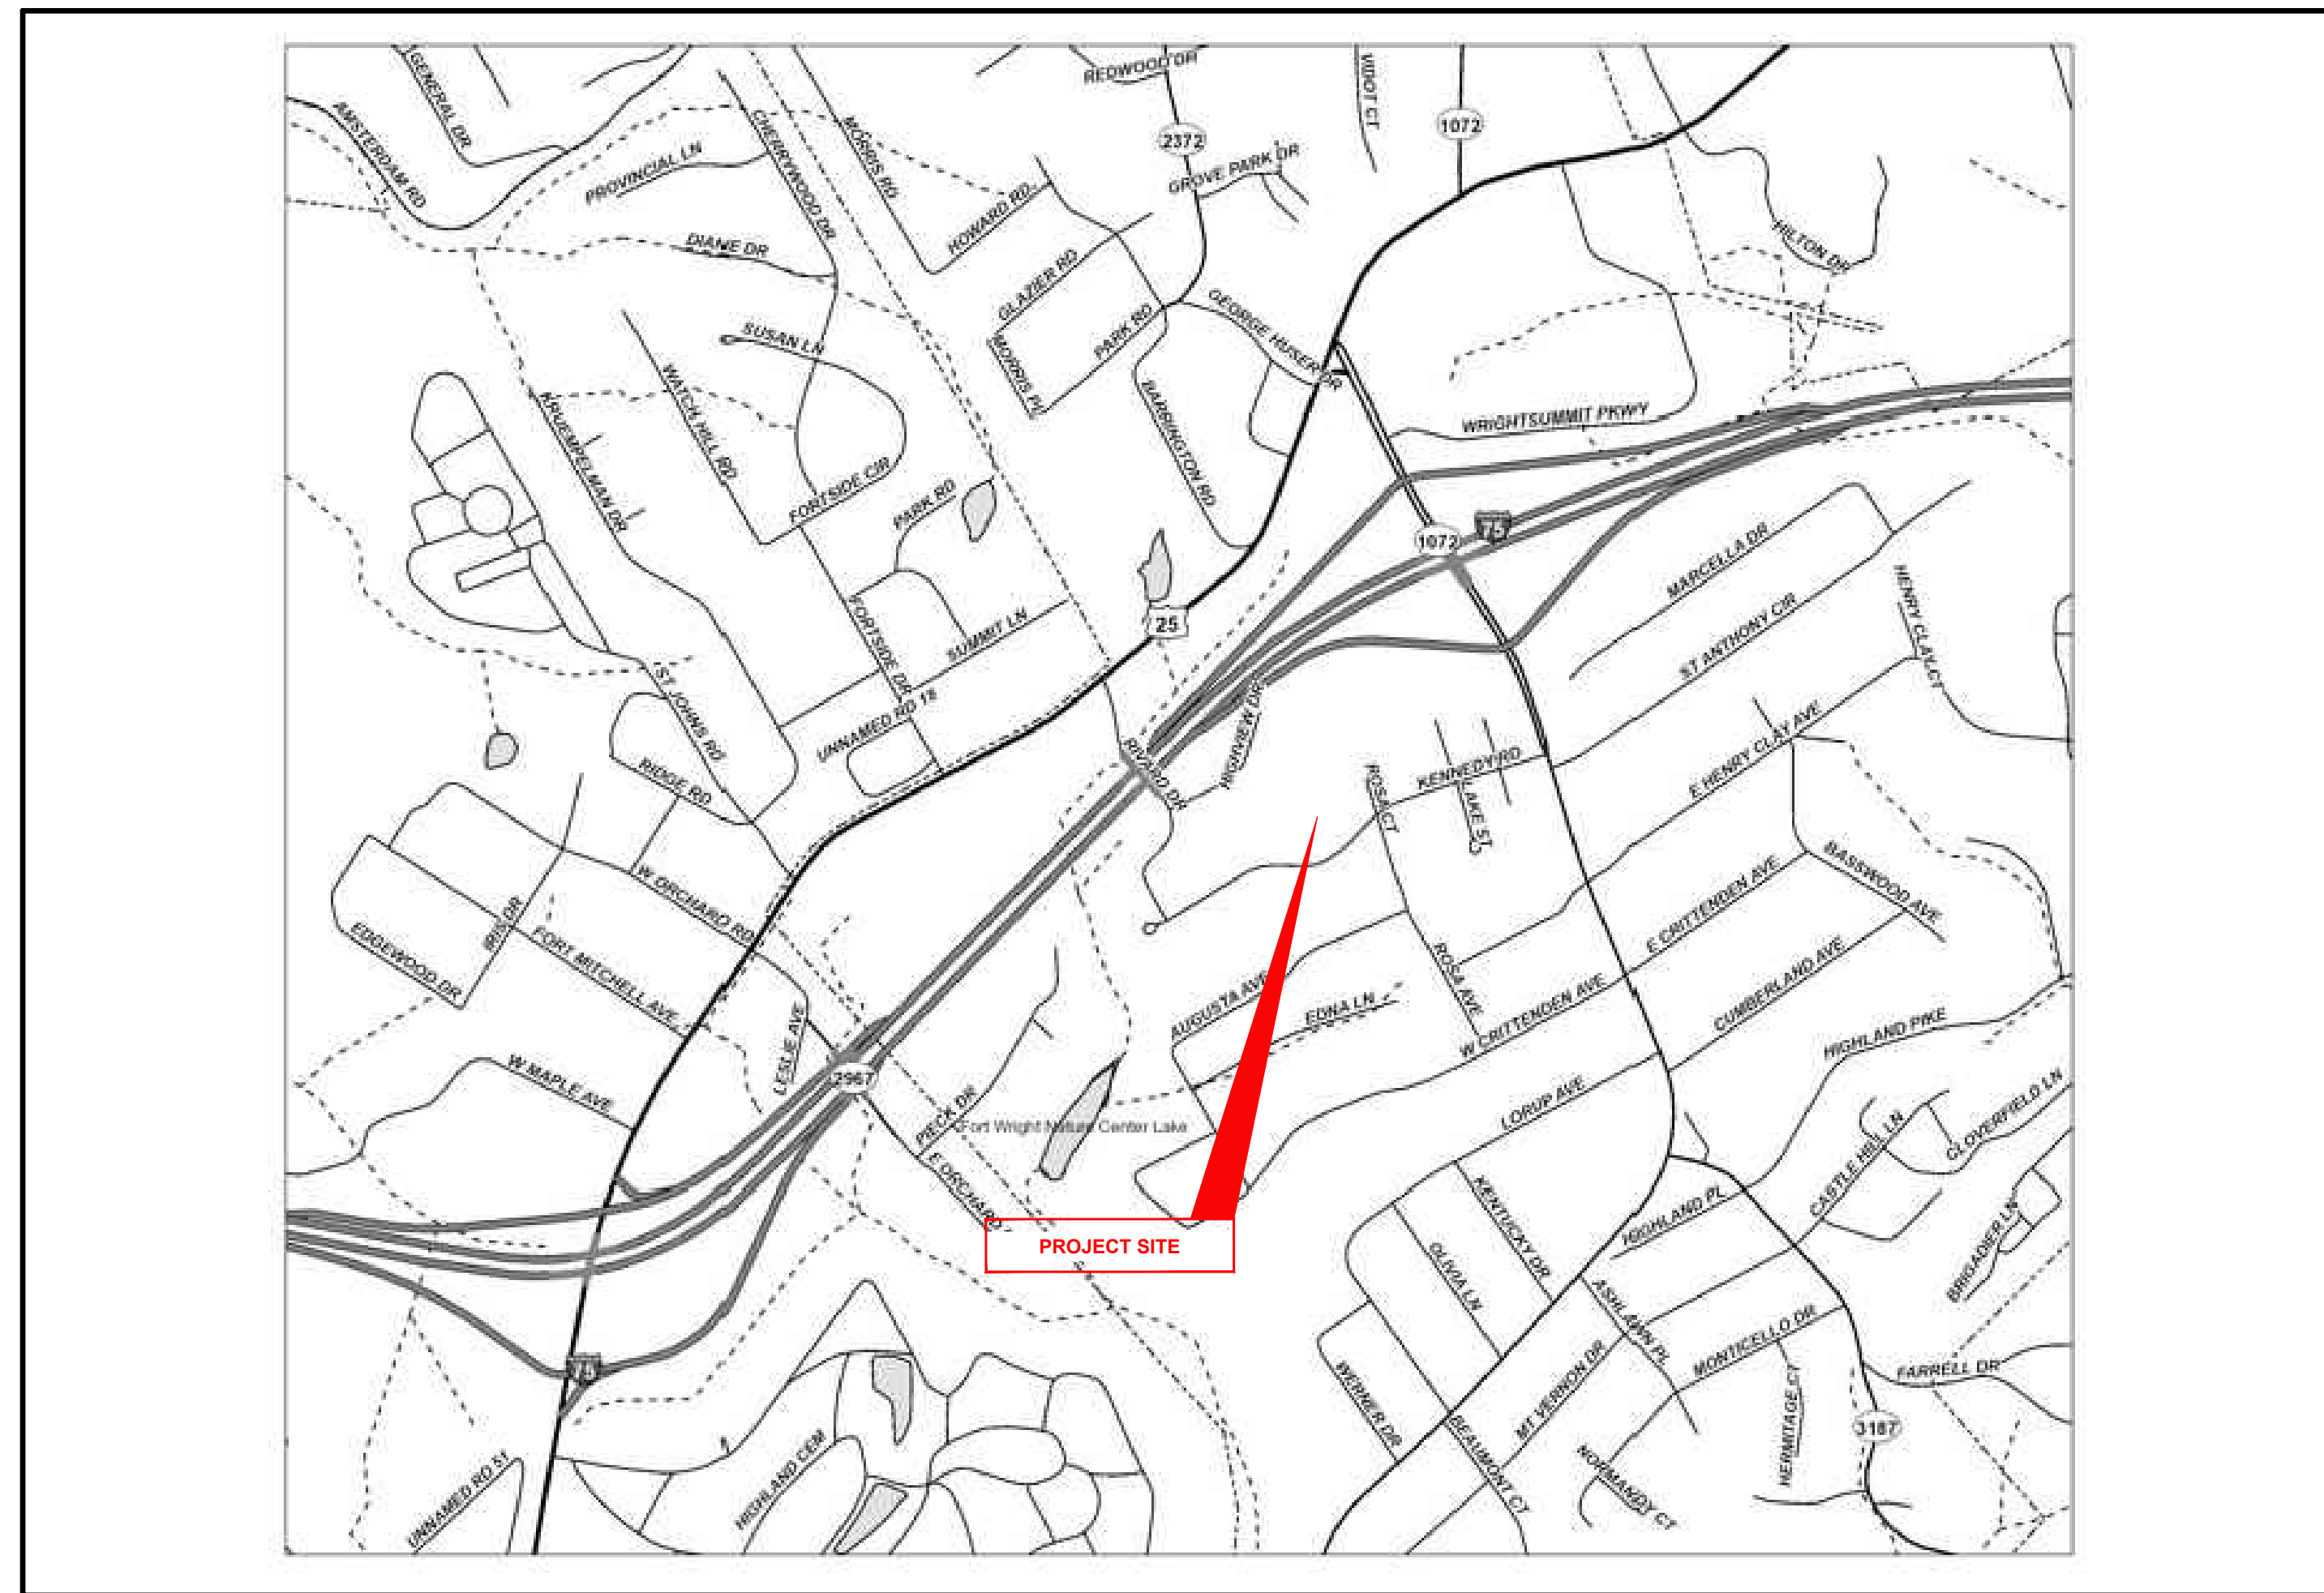

SITE MAP

**PROJECT SPECIFICATIONS**

THE LATEST STANDARD SPECIFICATIONS OF THE KENTUCKY DEPARTMENT OF TRANSPORTATION, INCLUDING CHANGES AND SUPPLEMENTAL SPECIFICATIONS THERETO, AND THE CITY OF FORT WRIGHT ENGINEERING DEPARTMENT SHALL GOVERN THIS PROJECT.

**SOURCE OF BOUNDARY INFORMATION**

THE BOUNDARY INFORMATION SHOWN ON THESE PLANS IS BASED UPON KENTON COUNTY G.I.S. MAPPING AND DOES NOT REPRESENT AN ACTUAL FIELD BOUNDARY SURVEY BY CT CONSULTANTS, INC.



NO	REVISION	DATE

**115 KENNEDY PLAYGROUND  
SITE GRADING  
CITY OF FORT WRIGHT  
KENTON COUNTY, KY**  
  
**TITLE SHEET**

PROJECT NO. <b>39397</b>	
DISCIPLINE <b>CIVIL</b>	
SHEET NAME <b>TTL</b>	
SHEET <b>1</b>	OF <b>7</b>

MARTIN P. HELLMANN

P.E. #27046

GENERAL NOTES
<p>1. ALL CONSTRUCTION SHALL CONFORM TO THESE PLANS AND SPECIFICATIONS, THE LATEST EDITION OF THE KENTON COUNTY SUBDIVISION REGULATIONS AND THE KENTUCKY DEPARTMENT OF HIGHWAYS STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.</p> <p>2. THERE SHALL BE NO DEVIATION FROM THE APPROVED PLANS WITHOUT PRIOR WRITTEN APPROVAL FROM THE OWNER OR THEIR REPRESENTATIVE. ANY DEVIATION FROM THESE PLANS WITHOUT PRIOR WRITTEN APPROVAL SHALL BE AT THE CONTRACTOR'S RISK AND EXPENSE.</p> <p>3. THE CONTRACTOR SHALL OBTAIN THE SERVICES OF A TESTING AGENCY FOR ALL REQUIRED TESTING.</p> <p>4. THE OWNER SHALL PROVIDE ALL CONSTRUCTION LAYOUT STAKING INCLUDING HORIZONTAL AND VERTICAL CONTROL. ANY DISCREPANCIES DISCOVERED IN THE PLAN INFORMATION, OR BETWEEN THE PLAN AND ELECTRONIC DATA SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE DESIGN ENGINEER SO THE APPROPRIATE ADJUSTMENTS MAY BE MADE.</p> <p>5. ALL WORK SHALL BE LIMITED TO THE PROPERTIES AND EASEMENTS IDENTIFIED ON THE PLANS. ANY WORK WITHIN THE PUBLIC RIGHT OF WAY IS SUBJECT TO INSPECTIONS AND ENCROACHMENT PERMITS FROM THE JURISDICTION HAVING AUTHORITY OVER THE RIGHT-OF-WAY. REQUIREMENTS OF SUCH PERMITS ARE INCORPORATED INTO THESE DOCUMENTS BY REFERENCE.</p> <p>6. ANY DEFECTS IN CONSTRUCTION, INCLUDING MATERIALS OR WORKMANSHIP, SHALL BE REPLACED OR CORRECTED BY THE CONTRACTOR BY REMOVAL AND REPLACEMENT OR OTHER APPROVED METHODS PRIOR TO ACCEPTANCE BY THE OWNER WITH NO ADDITIONAL COMPENSATION.</p> <p>7. CONTRACTOR SHALL SUBMIT A PLAN OF OPERATIONS FOR REVIEW AND APPROVAL BY THE ARCHITECT THAT WILL INDICATE EQUIPMENT STAGING AREAS, STOCKPILE LOCATION AND SANITATION FACILITIES.</p> <p>8. RIGHT-OF-WAY AND PROPERTY LINES SHOWN ARE PLOTTED FROM KENTON COUNTY G.I.S. MAPPING AND ARE APPROXIMATE AND NOT THE RESULT OF A FIELD BOUNDARY SURVEY.</p> <p>9. ALL OSHA, STATE AND LOCAL SAFETY REGULATIONS SHALL BE FOLLOWED DURING CONSTRUCTION.</p> <p>11. NO CONSTRUCTION SHALL COMMENCE UNTIL ALL KENTON COUNTY AND THE CITY OF FORT WRIGHT PERMITS HAVE BEEN ISSUED AS REQUIRE</p> <p>12. APPROPRIATE BARRICADES, WARNING LIGHTS, SIGNS, FENCING ETC. SHALL BE ERRECTED AROUND THE CONSTRUCTION AREA DURING NON-WORKING HOURS TO ALERT PERSONS OF THE POTENTIAL DANGER ASSOCIATED WITH THE AREA UNDER CONSTRUCTION AS WELL AS TO PREVENT ACCESS BY UNAUTHORIZED PERSONNEL. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THE SAFETY OF THE GENERAL PUBLIC AS WELL AS ALL CONSTRUCTION PERSONNEL.</p> <p>13. ANY EXISTING ROADWAY, LAWN, CURB, SIDEWALK OR OTHER APPURTENANCE DISTURBED DURING CONSTRUCTION NOT DESIGNATED FOR REMOVAL OR REPLACEMENT SHALL BE RESTORED BY THE CONTRACTOR WITHOUT ADDITIONAL COMPENSATION TO A CONDITION EQUAL TO OR BETTER THAN THAT WHICH EXISTED PRIOR TO DISTURBANCE.</p> <p>14. ANY TEMPORARY UTILITY REQUIRED BY THE CONTRACTOR (ELECTRIC, WATER ETC.) SHALL BE AT THE SOLE EXPENSE OF THE CONTRACTOR.</p> <p>15. THE CONTRACTOR SHALL PRESERVE ALL BENCHMARKS, PROPERTY LINE REFERENCES, REFERENCE POINTS, STAKES AND ANY OTHER SURVEY REFERENCE. IN CASE OF DISTURBANCE THE CONTRACTOR SHALL REPLACE THEM AT THE CONTRACTOR'S EXPENSE, BE RESPONSIBLE FOR ANY ERRORS THAT MAY BE CAUSED BY THEIR LOSS OR DISTURBANCE.</p> <p>16. ALL PROPOSED CONCRETE PAVEMENT ABUTTING EXISTING PAVEMENT SHALL BE DOWELED INTO EXISTING CONCRETE PAVEMENT USING A 3/4" DEFORMED DOWEL WITH 9" MINIMUM EMBEDMENT.</p> <p>17. THE CONTRACTOR SHALL COMPLY AT ALL TIMES WITH APPLICABLE FEDERAL, STATE AND LOCAL LAWS, PROVISIONS, AND POLICIES GOVERNING SAFETY AND HEALTH, INCLUDING THE FEDERAL CONSTRUCTION SAFETY ACT (PUBLIC LAW 91-54), FEDERAL REGISTER, CHAPTER XVII, PART 1926 OF TITLE 29 REGULATIONS, OCCUPATIONAL SAFETY AND HEALTH REGULATIONS FOR CONSTRUCTION, AND SUBSEQUENT PUBLICATIONS UPDATING THESE REGULATIONS.</p> <p>18. THE CONTRACTOR SHALL BE RESPONSIBLE FOR EXAMINING THE AREAS AND CONDITIONS UNDER WHICH THE PROJECT IS TO BE CONSTRUCTED PRIOR TO THE SUBMISSION OF THE BID. SUBMISSION OF A BID SHALL BE CONSTRUED TO MEAN THE CONTRACTOR HAS REVIEWED THE SITE AND IS FAMILIAR WITH THE CONDITIONS AND CONSTRAINTS OF THE SITE.</p> <p>19. CONTRACTOR SHALL REFER TO OTHER PLANS WITHIN THIS CONSTRUCTION SET FOR OTHER PERTINENT INFORMATION.</p>

**ACCESSIBILITY NOTES**

<p>1. ALL REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT (ADA) SHALL BE FOLLOWED IN ALL ASPECTS OF THE PROJECT.</p> <p>2. ALL SIDEWALKS INSTALLED SHALL HAVE A MAXIMUM CROSS SLOPE OF 2%</p> <p>3. HANDICAP ACCESSIBLE PARKING SPACES SHALL NOT EXCEED A SLOPE OF 2% IN ANY DIRECTION</p> <p>4. ALL CURB RAMPS SHOWN ALONG A DESIGNATED ACCESSIBLE ROUTE SHALL BE FLUSH WITH THE ADJACENT PAVEMENT.</p>
--

**GAS NOTES**

<p>1. ALL WORK RELATING TO GAS MAINS OR GAS SERVICE LINES SHALL BE COMPLETED IN ACCORDANCE WITH THE RULES AND REGULATIONS OF THE DUKE ENERGY</p>
--

**ELECTRIC NOTES**

<p>1. ALL WORK RELATING TO ELECTRIC LINES SHALL BE COMPLETED IN ACCORDANCE WITH THE RULES AND REGULATIONS OF THE DUKE ENERGY</p>
--

UTILITY NOTES
<p>1. THIS PLAN SHOWS THE APPROXIMATE LOCATION OF UNDERGROUND UTILITIES (GAS, WATER, STORM SEWER, SANITARY SEWER, TELEPHONE, ELECTRIC, ETC.). THE PREPARER DOES NOT GUARANTEE THEIR ACCURACY OR CORRECTNESS. THE INFORMATION PROVIDED SHALL BE FIELD VERIFIED PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING THE UTILITY AS WELL AS THE SERVICE LATERALS AT ALL TIMES DURING CONSTRUCTION. THE CONTRACTOR SHALL PRACTICE CARE DURING THE GRADING AND TRENCH EXCAVATION AND SHALL BE RESPONSIBLE FOR REPLACING ANY SERVICES THAT ARE DAMAGED DURING CONSTRUCTION AT THEIR EXPENSE.</p> <p>2. PRIOR TO ANY EXCAVATION OVER AN EXISTING UTILITY LINE OR SERVICE, CONTRACTOR SHALL HAND EXCAVATE TO EXPOSE THE UTILITY AND DETERMINE LOCATION AND DEPTH. NOTIFY ENGINEER IMMEDIATELY OF ANY CONFLICTS.</p> <p>3. TOPS OF EXISTING AND PROPOSED CASTING ELEVATIONS ARE SUBJECT TO FINAL ADJUSTMENTS AS APPROVED BY THE ENGINEER AND REQUIREMENTS OF UTILITY OWNER. THIS WORK WILL BE INCIDENTAL TO THE CONTRACT.</p> <p>4. FORTY-EIGHT (48) HOURS BEFORE EXCAVATION IS TO COMMENCE, THE CONTRACTOR SHALL NOTIFY THE FOLLOWING AGENCIES: THE KENTUCKY UTILITY PROTECTION SERVICE AND ALL OTHER UTILITIES THAT MAY HAVE UNDERGROUND UTILITIES INVOLVING THIS PROJECT AND ARE NON-MEMBERS OF KENTUCKY UNDERGROUND PROTECTION.</p> <p>5. THE SITE MAY CONTAIN EXISTING PRIVATELY OWNED UTILITIES. THESE HAVE BEEN SHOWN AS ACCURATELY AS POSSIBLE BASED ON EXISTING UTILITY INFORMATION, BUT THE PREPARER OF THESE DOCUMENTS DOES NOT ATTEST TO THEIR ACCURACY OR CORRECTNESS. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO CONTRACT WITH A PRIVATE UTILITY MARKING AGENCY TO IDENTIFY AND LOCATE ALL PRIVATE UTILITIES WITHIN THE WORK SITE. THIS MAY INVOLVE THE EXCAVATION AND UNCOVERING OF UTILITIES TO VERIFY LOCATION. NOTIFY ENGINEER IMMEDIATELY OF ANY CONFLICTS. CONTRACT SHALL MAKE RECORDS OF ALL PRIVATE UTILITIES ENCOUNTERED DURING THE PROJECT.</p> <p>6. RECORD DRAWINGS OF NEW UTILITY SERVICES SHALL BE PREPARED BY THE CONTRACTOR AND SUBMITTED TO THE OWNER UPON COMPLETION OF THE PROJECT.</p>

**STORM & SANITARY NOTES**

<p>1. ALL STORM AND SANITARY ITEMS SHALL BE IN ACCORDANCE WITH THE LATEST SPECIFICATIONS AND DETAILS FROM SD1. CONCRETE AND METAL PIPE MATERIALS SHALL NOT BE USED UNLESS OTHERWISE SPECIFIED ON THESE PLANS.</p> <p>2. CONTRACTOR SHALL BE REQUIRED TO MAINTAIN STORM AND SANITARY SEWER FLOW THROUGHOUT THE PROJECT. FOR THE DURATION OF CONSTRUCTION. ALL COST FOR THE ABOVE SHALL BE INCIDENTAL TO THE CONTRACT.</p> <p>3. IF REQUIRED, CONTRACTOR SHALL BE RESPONSIBLE FOR CONTACTING AND SCHEDULING STORM AND SANITARY SEWER INSPECTIONS AS SET OUT IN THE PRECONSTRUCTION MEETING.</p> <p>4. CONNECTIONS INTO EXISTING OR PROPOSED STORM OR SANITARY SEWER STRUCTURES OR PIPES SHALL BE COMPLETED BY A CERTIFIED TAPPER BY SD1.</p> <p>5. DOWNSPOUT AND UNDERDRAIN CONSTRUCTION SHALL MEET THESE AND THE LATEST SPECIFICATION OF THE KENTON COUNTY SUBDIVISION REGULATIONS, SD-1 REGULATIONS AND STANDARD DRAWINGS, AND DETAILS SHOWN ON THIS PLAN. BEDDING, BACKFILLING, JOINTS, EXCAVATION AND INSTALLATION SHALL BE INCLUDED IN THE COST PER FOOT OF PIPE. STORM SEWER, DOWNSPOUT AND UNDERDRAIN PIPE MATERIAL SHALL HAVE A MANNING'S "N" VALUE OF 0.013 OR LESS (UNLESS OTHERWISE SHOWN) AND BE RIGID / SMOOTH INTERIOR WALLED PVC SDR-35 PIPE, RIBBED PVC PIPE, A-2000 PVC PIPE, UNLESS OTHERWISE SHOWN.</p> <p>6. ROOF DRAINS, FOUNDATION DRAINS AND OTHER CLEAN WATER CONNECTIONS TO THE SANITARY SEWER SYSTEM ARE PROHIBITED.</p> <p>7. CONTRACTOR TO PROVIDE SHOP DRAWINGS ON ALL STORM SEWER MANHOLES, INLETS AND DETENTION SYSTEMS.</p> <p>8. CONTRACTOR SHALL ASSURE THAT THERE IS POSITIVE DRAINAGE TO THE INLETS UPON PLACEMENT OF NEW PAVEMENT</p>
--

**WATER NOTES**

<p>1. ALL WORK RELATING TO WATER MAINS OR WATER SERVICE LINES SHALL BE COMPLETED IN ACCORDANCE WITH THE RULES AND REGULATIONS OF THE NORTHERN KENTUCKY WATER DISTRICT (NKWD).</p> <p>2. CONTRACTOR MAY NOT USE WATER FROM FIRE HYDRANTS WITHOUT PRIOR PERMISSION FROM NKWD</p> <p>3. MAINTAIN A MINIMUM 10' HORIZONTAL SEPARATION AND 18" VERTICAL SEPARATION FROM ALL SANITARY SEWERS.</p>
---

**GAS NOTES**

































































**ELECTRIC NOTES**

<p>1. ALL WORK RELATING TO ELECTRIC LINES SHALL BE COMPLETED IN ACCORDANCE WITH THE RULES AND REGULATIONS OF THE DUKE ENERGY</p>
--








MAINTENANCE OF TRAFFIC NOTES
<p>1. ALL MAINTENANCE OF TRAFFIC PROCEDURES SHALL MEET THE REQUIREMENT OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES AND SECTION 112 OF KTC STANDARD SPECIFICATIONS. THE CONTRACTOR SHALL MAINTAIN ACCESS TO LOCAL TRAFFIC (ACCESS TO RESIDENCES WITHIN CONSTRUCTION LIMITS) AT ALL TIMES. THE CONTRACTOR SHALL PROVIDE SUFFICIENT SIGN, WARNING LIGHTS, BARRICADES, OR OTHER NECESSARY DEVICES MAKE THE SITE SAFE TO THE TRAVELING PUBLIC.</p> <p>2. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO SUBMIT TO THE ENGINEER AND THE OWNER A TRAFFIC CONTROL PLAN FOR THIS PROJECT.</p> <p>3. PRIOR TO ANY CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE CITY OF FORT WRIGHT AND THE FORT WRIGHT POLICE DEPARTMENT. AT ALL TIMES, EMERGENCY VEHICLES SHALL BE GIVEN ACCESS.</p> <p>4. RESIDENTS OF THE PROJECT AREA SHALL BE ALLOWED ACCESS TO THEIR PROPERTY AT ALL TIMES.</p> <p>5. ALTERNATE ROUTES OR CONTINUOUS TRAFFIC CONTROL SHALL BE EMPLOYED WHEN A PUBLIC WAY IS TEMPORARY BLOCKED DURING CONSTRUCTION, INCLUDING PEDESTRIAN AND BICYCLE FACILITIES. ADVANCED NOTICE SIGNS IN ACCORDANCE WITH THE MUTCD SHALL BE EMPLOYED.</p>

**GRADING AND EROSION CONTROL NOTES**



<p>1. ALL DISTURBED AREAS ARE TO BE RESTORED (SEEDED AND MULCHED) BY THE CONTRACTOR AND SHALL PROCEED WITH JOB PROGRESSION. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR REMOVING ANY EXCESS MATERIALS AT THE SITE AND MAINTAINING ALL SEEDED AND MULCHED AREAS UNTIL PROJECT COMPLETION AND FINAL INSPECTION PER KDOT SPEC. 212. ALL DISTURBED AREAS SHALL BE RESTORED WITHIN TWENTY-ONE (21) DAYS AFTER CONSTRUCTION.</p> <p>2. ALL APPLICABLE RECOMMENDATIONS IN KENTUCKY'S BEST MANAGEMENT PRACTICES MANUAL SHALL BE FOLLOWED BY THE CONTRACTOR, INCLUDING SEEDING OF DISTURBED GROUND.</p> <p>3. ADDITIONAL BMP'S AND EROSION AND SEDIMENT CONTROL MEASURES MAY BE REQUIRED AS DEEMED NECESSARY. ALL COST FOR ABOVE SHALL BE INCLUDED IN LUMP SUM BID FOR EROSION CONTROL AND WATER POLLUTION CONTROL.</p> <p>4. ALL EXCAVATION IS CONSIDERED UNCLASSIFIED AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEANS, METHODS AND MATERIALS OF CONSTRUCTION. THE DESIGN ENGINEER SHALL NOT BE RESPONSIBLE FOR THE SUITABILITY OF MATERIAL UNDERLYING THE PROJECT SITE. THE CONTRACTOR SHALL PERFORM ANY INVESTIGATIONS OR TESTING NECESSARY TO ADEQUATELY DETERMINE OR ESTIMATE TO THEIR SATISFACTION ANY EXISTING SITE CONDITION WHICH COULD AFFECT HIS BID OR THE PERFORMANCE OF THE PROPOSED IMPROVEMENTS. THIS COULD INCLUDE, BUT NOT BE LIMITED TO, UNSUITABLE OR UNSTABLE SOIL/SUBSURFACE CONDITIONS, ROCK, WATER (PERCHED OR FREE), OBSTRUCTIONS ETC.</p> <p>5. ALL TREES AND OTHER VEGETATION WITHIN THE PROJECT LIMITS THAT INTERFERE WITH CONSTRUCTION SHALL BE REMOVED, INCLUDED STUMP REMOVAL.</p> <p>6. THE CONTRACTOR SHALL REMOVE ALL SURPLUS DEMOLISHED AND WASTE MATERIALS, INCLUDING TREES, STUMPS, TRASH AND DEBRIS, FROM THE PROJECT LIMITS AND DISPOSE OF OFF-SITE. IN NO INSTANCE SHALL MATERIAL BE BURIED ON-SITE.</p> <p>7. THE CONTRACTOR SHALL REMOVE FROM THE SITE ALL MATERIAL DEEMED UNSUITABLE FOR EMBANKMENT BY THE OWNER'S REPRESENTATIVE AND BE DISPOSED OF OFF-SITE.</p> <p>8. THE CONTRACTOR SHALL PROVIDE FINAL GRADING TO WITHIN 1" OF GRADES SHOWN ON THE PLANS.</p> <p>9. TOPSOIL SHALL BE STRIPPED AND SOCKPILED FROM ALL AREAS TO BE GRADED. TO WHATEVER DEPTH ENCOUNTERED, AND IN A MANNER TO PREVENT INTERMIXING WITH UNDERLYING SUBSOIL. SOIL SHALL NOT BE STOCKPILED NEAR THE EDGE OF EXCAVATIONS OR WITHIN DRIP LINES OF TREES TO REMAIN.</p> <p>10. EXCESS SOIL GENERATED FROM TRENCH EXCAVATIONS SHALL BE INCORPORATED IN THE UNIT PRICE BID FOR EXCAVATION INCLUDING EMBANKMENT CONSTRUCTION. ANY EXCESS SOIL UNABLE TO BE PLACED ON-SITE OR DEEMED UNSUITABLE FOR EMBANKMENT BY THE ENGINEER SHALL BE DISPOSED OF OFF-SITE.</p> <p>11. THE CONTRACTOR SHALL FOLLOW THE RECOMMENDATIONS IN THE SUBSURFACE EXPLORATION AND GEOTECHNICAL ENGINEERING REPORT FOR EXCAVATION AND EMBANKMENT TO CONSTRUCT THE IMPROVEMENTS AND ACHIEVE THE FINISHED GRADES SHOWN ON THE PLANS.</p> <p>12. NO SLAG, RIVER GRAVEL, RECYCLED PORTLAND CEMENT CONCRETE, RECLAIMED ASPHALT CONCRETE PAVEMENT OR RECLAIMED BITUMINOUS AGGREGATE BASE SHALL BE USED AS FILL.</p> <p>13. EXPOSED PAVEMENT SUBGRADE AREAS SHALL BE MAINTAINED IN CONDITIONS TO PREVENT PONDING OF WATER AFTER RAINS.</p> <p>14. ALL EXISTING AND PROPOSED MANHOLE COVERS, VALVE BOXES, ETC. LOCATED WITHIN PEDESTRIAN ACCESS SHALL BE FLUSH MOUNTED WITH THE WALKING SURFACE.</p> <p>15. SLOPE ALL PAVING AND LANDSCAPE AREAS AWAY FROM THE BUILDING AT A MINIMUM OF 1%</p> <p>16. THE ENGINEER MAKES NO REPRESENTATION AS TO A BALANCED EARTHWORK SITE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING THE FINAL SITE GRADES AS INDICATED ON THE GRADING PLAN, INCLUDING THE IMPORT OR EXPORT OF MATERIAL IF REQUIRED TO ACHIEVE THE PROPOSED GRADES. ADDITIONALLY, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER REMOVAL AND DISPOSAL OF ALL SURPLUS EARTHWORK, DEBRIS OR WASTE FROM THE SITE. ALL COST FOR THE ABOVE SHALL BE INCLUDED IN THE CONTRACTORS BID PRICE FOR EXCAVATION AND/OR EMBANKMENT.</p> <p>17. THE CONTRACTOR SHALL PROTECT STRUCTURES, UTILITIES, SIDEWALKS, PAVEMENTS AND OTHER FACILITIES TO REMAIN FROM DAMAGE CAUSED BY EARTHWORK OPERATIONS.</p> <p>18. MAINTENANCE OF ALL TEMPORARY AND PERMANENT EROSION AND SEDIMENT CONTROL FACILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR(S)</p> <p>19. CONTRACTOR SHALL PROVIDE WRITTEN DOCUMENTATION OF REPAIR AND/OR REPLACEMENT OF BMP'S</p>
--

SYMBOL LEGEND
 EXISTING GAS LINE  EXISTING GAS SERVICE  EXISTING ELECTRIC (UNDERGROUND / OVERHEAD)  EXISTING CABLE (UNDERGROUND / OVERHEAD)  EXISTING TELEPHONE (UNDERGROUND / OVERHEAD)  EXISTING WATER MAIN  EXISTING WATER SERVICE  EXISTING STORM SEWER  EXISTING ROOF DRAIN  EXISTING SANITARY SEWER  EXISTING SANITARY FORCE MAIN  EXISTING FIBER OPTICS  EXISTING CONTOURS (MAJOR)  EXISTING CONTOURS (MINOR)  EXISTING RIGHT OF WAY  EXISTING PROPERTY LINE  EXISTING EASEMENT  EXISTING GUARDRAIL  EXISTING TREE LINE   PROPOSED GAS LINE  PROPOSED GAS SERVICE  PROPOSED ELECTRIC (UNDERGROUND / OVERHEAD)  PROPOSED CABLE (UNDERGROUND / OVERHEAD)  PROPOSED TELEPHONE (UNDERGROUND / OVERHEAD)  PROPOSED WATER MAIN  PROPOSED WATER SERVICE  PROPOSED STORM SEWER  PROPOSED UNDERDRAIN  PROPOSED UNDERDRAIN / DOWNSPOUT COLLECTOR COMB  PROPOSED SANITARY SEWER  PROPOSED SANITARY FORCE MAIN  PROPOSED FIBER OPTICS  PROPOSED FENCE  PROPOSED CONTOURS (MAJOR)  PROPOSED CONTOURS (MINOR)  PROPOSED RIGHT OF WAY  PROPOSED PROPERTY LINE  PROPOSED EASEMENT  PROPOSED GUARDRAIL  PROPOSED TREE LINE / CLEARING LIMITS  PROPOSED DISTURBED LIMITS   EXISTING FLAGPOLE  EXISTING MAILBOX  EXISTING SIGN  EXISTING CABLE PEDESTAL  EXISTING ELECTRIC PEDESTAL  EXISTING PULL BOX  EXISTING GROUND LIGHT  EXISTING LIGHT POLE  EXISTING ELECTRIC METER  EXISTING ELECTRIC MANHOLE  EXISTING GAS METER  EXISTING GAS VALVE  EXISTING GAS BOX  EXISTING UTILITY POLE  EXISTING GUY WIRE / ANCHOR  EXISTING SANITARY MANHOLE  EXISTING SANITARY CLEANOUT  EXISTING STORM MANHOLE  EXISTING SINGLE / DOUBLE CURB INLET  EXISTING CATCH BASIN  EXISTING STORM CLEANOUT  EXISTING TELEPHONE MANHOLE  EXISTING TELEPHONE PEDESTAL  EXISTING FIRE HYDRANT  EXISTING WATER METER  EXISTING WATER VALVE  EXISTING BUSHES / TREES  EXISTING SURVEY BENCHMARK  TEST BORING LOCATION   PROPOSED FLAGPOLE  PROPOSED MAILBOX  PROPOSED SIGN  PROPOSED CABLE PEDESTAL  PROPOSED ELECTRIC PEDESTAL  PROPOSED PULL BOX  PROPOSED GROUND LIGHT  PROPOSED LIGHT POLE  PROPOSED ELECTRIC METER  PROPOSED ELECTRIC MANHOLE  PROPOSED GAS METER  PROPOSED GAS VALVE  PROPOSED GAS BOX  PROPOSED UTILITY POLE  PROPOSED GUY WIRE / ANCHOR  PROPOSED SANITARY MANHOLE  PROPOSED SANITARY CLEANOUT  PROPOSED STORM MANHOLE  PROPOSED SINGLE / DOUBLE CURB INLET  PROPOSED CATCH BASIN  PROPOSED STORM CLEANOUT  PROPOSED TELEPHONE MANHOLE  PROPOSED TELEPHONE PEDESTAL  PROPOSED FIRE HYDRANT  PROPOSED WATER METER  PROPOSED WATER VALVE  PROPOSED SLOPE DIRECTION 

**EROSION CONTROL LEGEND**

 INLET PROTECTION (SEE DETAIL)  CHECK DAM  CONSTRUCTION ENTRANCE  CONCRETE WASHOUT  ROCK CHANNEL PROTECTION  SKIMMER DEWATERING DEVICE  PROPOSED SILT FENCE
---

**HATCH LEGEND**

 4" CONCRETE SIDEWALK  EXISTING PAVEMENT TO BE REMOVED
---

verdantas

300 BUTTERMILK PIKE, SUITE 332  
 FORT MITCHELL, KENTUCKY 41017  
 TEL: (609) 525-0944  
 WWW.VERDANTAS.COM

REVISION		DATE
NO		

BIDDING	ISSUED FOR:	ISSUE DATE:	SCALE:	DESIGNED BY:	DRAWN BY:	CHECKED BY:
05/28/2026	115 KENNEDY PLAYGROUND	05/28/2026	1"=10'	DGAR	DGAR	MHEL

115 KENNEDY PLAYGROUND


SITE GRADING

CITY OF FORT WRIGHT

KENTON COUNTY, KY

GENERAL NOTES & LEGEND


PROJECT NO.	
39397	
DISCIPLINE	
CIVIL	
SHEET NAME	
NOTES	
SHEET	OF
2	7

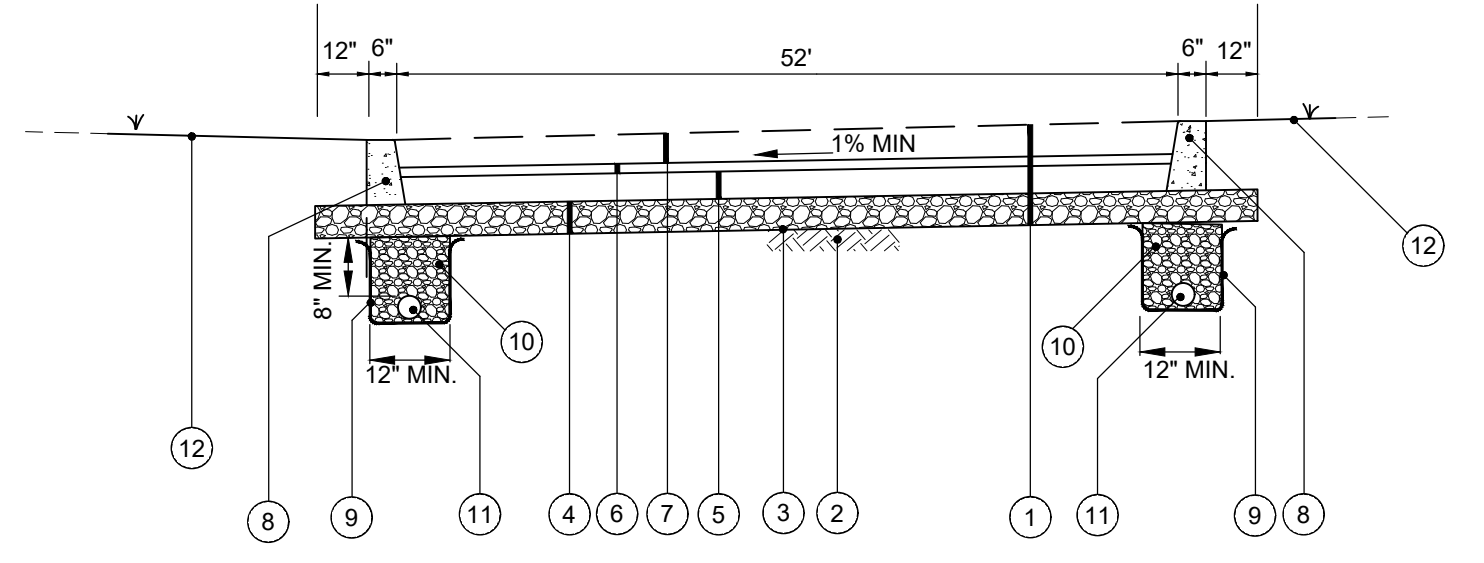

**PROPOSED PAVEMENT REPLACEMENT BOX CURB SECTION WITH EDGE DRAIN**  
N.T.S.


- 1 REMOVE EXISTING PAVEMENT AND EXCAVATE TO PROPOSED SUBGRADE
- 2 ITEM 207 - SUBGRADE RESHAPING AND COMPACTING, SUBGRADE SHALL BE TRIMMED AND ROLLED SMOOTH FOR DRAINAGE TO GEOTEXTILE CAN BE SPREAD SMOOTH, TAUT AND EVEN BEFORE STONE IS PLACED
- 3 ITEM 214 - WOVEN GEOTEXTILE, MIRAFI 600X OR EQUIVALENT, ALL OVERLAPS TO BE 18" MIN. PLACED ON SUBGRADE BETWEEN UNDERDRAINS
- 4 ITEM 302 - 4" NO. 57 STONE BASE COMPACTED TO 98%
- 5 ITEM 302 - 2" NO. 57 STONE BASE PLACED AFTER CURB PLACEMENT
- 6 ITEM 302 - 1" NO. 9 STONE LEVELING LAYER
- 7 RESERVE 3" FOR FUTURE RUBBER SURFACE (2.5" BUFFER LAYER, 0.5" COLOR LAYER) TO BE INSTALLED BY OTHERS
- 8 ITEM SPL - 6" TALL x 6" WIDE CONCRETE CURB
- 9 ITEM SPL - NONWOVEN GEOTEXTILE, MIRAFI 140 N OR EQUIVALENT (INCIDENTAL TO PIPE UNDERDRAIN)
- 10 ITEM 302 - CLEAN NO. 57 CRUSHED STONE (LESS THAN 3% FINES) (INCIDENTAL TO PIPE UNDERDRAIN)
- 11 ITEM 704 - 4" RIGID PVC PERFORATED PIPE UNDERDRAIN
- 12 ITEM SPL - YARD RESTORATION (4" TOPSOIL, SEED AND MULCH)

**\*NOTE:**  
SUBGRADE RESHAPING AND COMPACTING SHALL BE PER KTC ITEM 207. A PROOF ROLL WILL BE REQUIRED PRIOR TO PLACING STONE BASE OR CONCRETE PAVEMENT. SOFT OR YIELDING SUITABLE SUBGRADE MATERIAL LACKING PROPER COMPACTION OR MOISTURE CONTENT SHALL BE SCARIFIED, AERATED, DRIED, AND RECOMPACTED. SOFT OR YIELDING UNSUITABLE SUBGRADE SHALL BE REMOVED AND REPLACED PER THE "PAVEMENT REPLACEMENT W/ EDGE DRAIN AND GEOGRID REINFORCEMENT" DETAIL, AS DIRECTED BY THE ENGINEER.

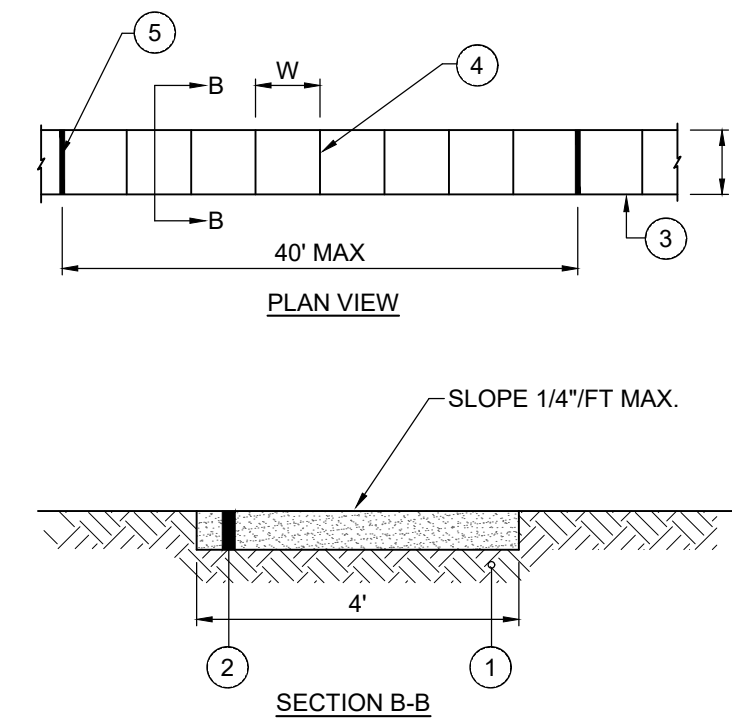


**CONCRETE SIDEWALK DETAIL**

- 1 ITEM 207 - COMPACTED SUBGRADE (INCIDENTAL TO CONCRETE SIDEWALK)
- 2 ITEM SPL - 4" CONCRETE SIDEWALK PER KENTON COUNTY SUBDIVISION REGULATIONS
- 3 TOOLED EDGE
- 4 TOOLED CONTRACTION JOINT
- 5 3/8" PREMOLDED EXPANSION JOINT

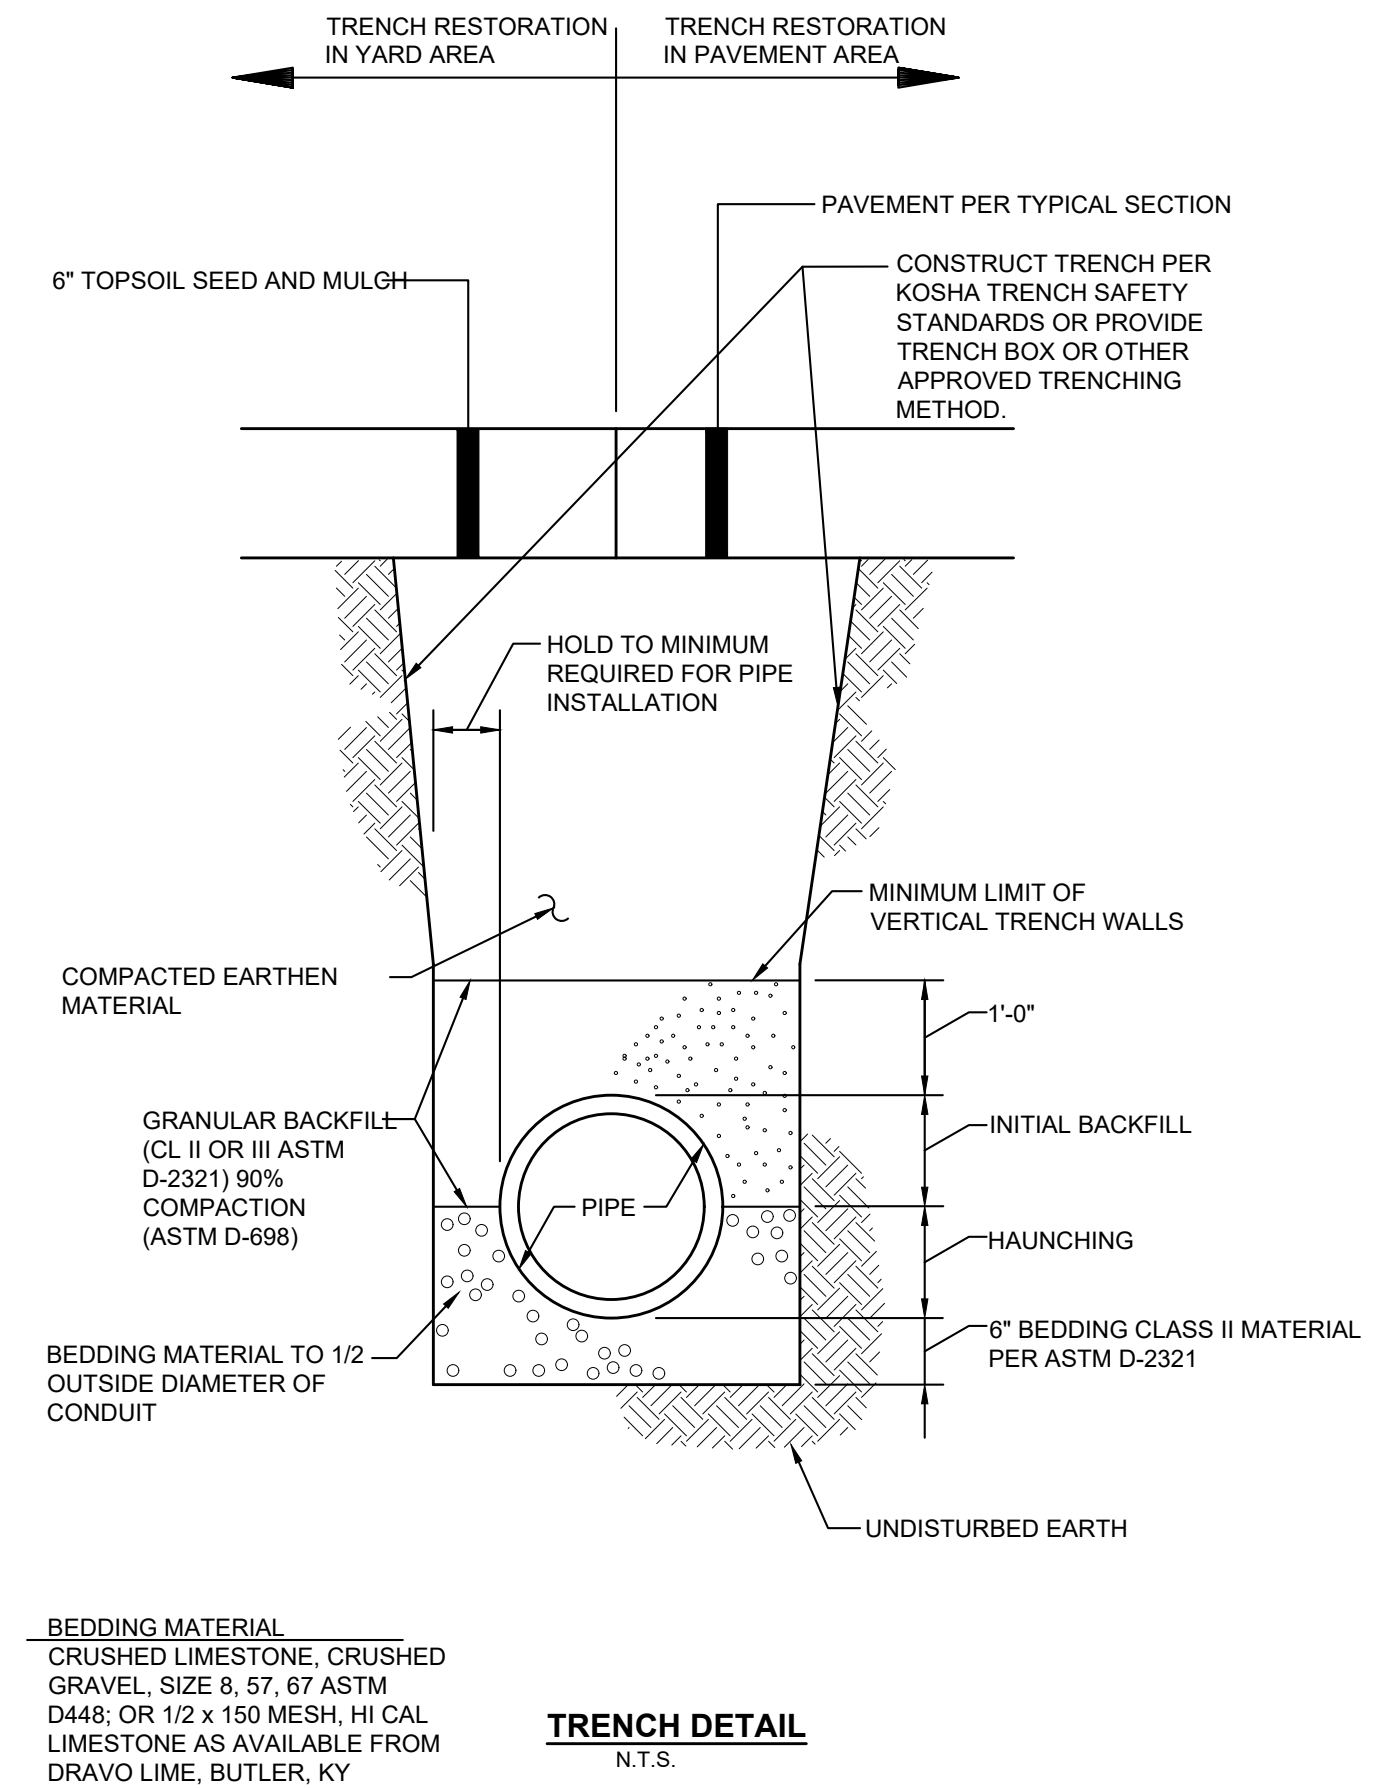

**TRENCH DETAIL**  
N.T.S.


**BEDDING MATERIAL**  
CRUSHED LIMESTONE, CRUSHED GRAVEL, SIZE 8, 57, 67 ASTM D448; OR 1/2 x 150 MESH, HI CAL LIMESTONE AS AVAILABLE FROM DRAVO LIME, BUTLER, KY

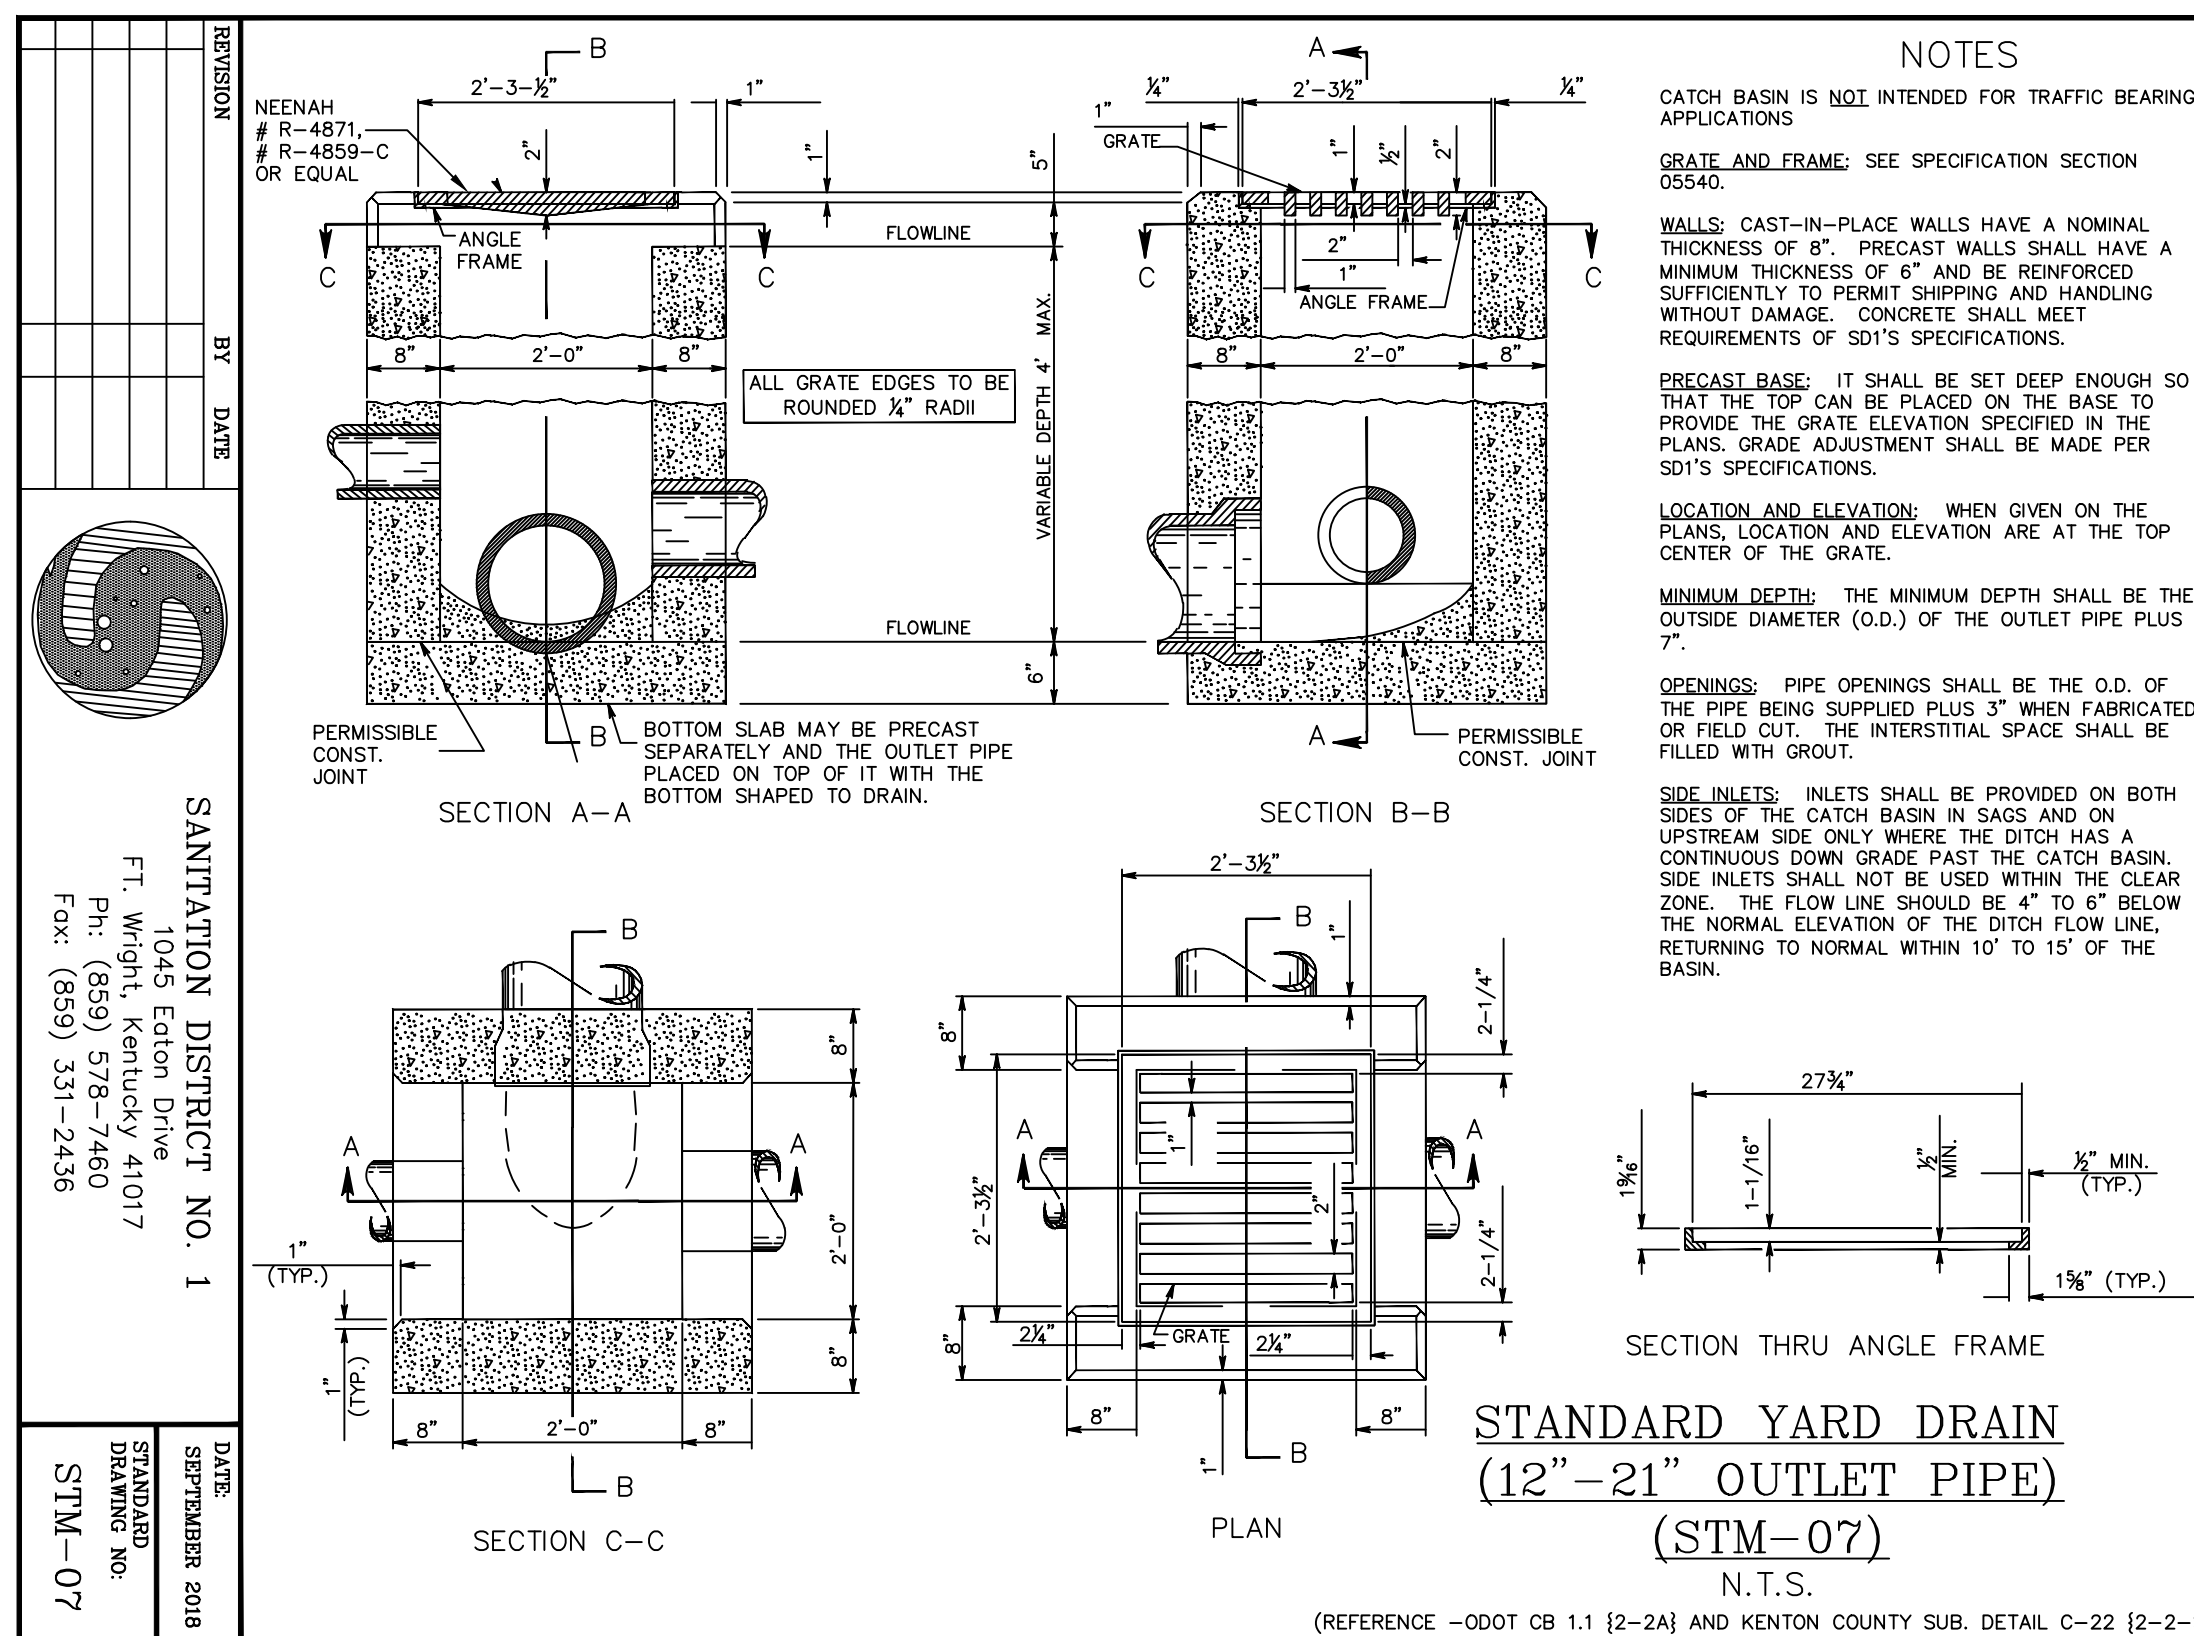

**STANDARD YARD DRAIN**  
**(12" - 21" OUTLET PIPE)**  
**(STM-07)**  
N.T.S.

(REFERENCE -000T CB 1.1 [2-2A] AND KENTON COUNTY SUB. DETAIL C-22 [2-2-3])

**NOTES**  
CATCH BASIN IS NOT INTENDED FOR TRAFFIC BEARING APPLICATIONS  
GRATE AND FRAME: SEE SPECIFICATION SECTION 05540.  
WALLS: CAST-IN-PLACE WALLS HAVE A NOMINAL THICKNESS OF 8". PRECAST WALLS SHALL HAVE A MINIMUM THICKNESS OF 6" AND BE REINFORCED SUFFICIENTLY TO PERMIT SHIPPING AND HANDLING WITHOUT DAMAGE. CONCRETE SHALL MEET REQUIREMENTS OF SD1'S SPECIFICATIONS.  
PRECAST BASE: IT SHALL BE SET DEEP ENOUGH SO THAT THE TOP CAN BE PLACED ON THE BASE TO PROVIDE THE GRADE ELEVATION SPECIFIED IN THE PLANS. GRADE ADJUSTMENT SHALL BE MADE PER SD1'S SPECIFICATIONS.  
LOCATION AND ELEVATION: WHEN GIVEN ON THE PLANS, LOCATION AND ELEVATION ARE AT THE TOP CENTER OF THE GRATE.  
MINIMUM DEPTH: THE MINIMUM DEPTH SHALL BE THE OUTSIDE DIAMETER (O.D.) OF THE OUTLET PIPE PLUS 7".  
OPENINGS: PIPE OPENINGS SHALL BE THE O.D. OF THE PIPE BEING SUPPLIED PLUS 3" WHEN FABRICATED OR FIELD CUT. THE INTERSTITIAL SPACE SHALL BE FILLED WITH GROUT.  
SIDE INLETS: INLETS SHALL BE PROVIDED ON BOTH SIDES OF THE CATCH BASIN IN SAGS AND ON UPSTREAM SIDE ONLY WHERE THE DITCH HAS A CONTINUOUS DOWN GRADE PAST THE CATCH BASIN. SIDE INLETS SHALL NOT BE USED WITHIN THE CLEAR ZONE. THE FLOW LINE SHOULD BE 4" TO 6" BELOW THE NORMAL ELEVATION OF THE DITCH FLOW LINE, RETURNING TO NORMAL WITHIN 10' TO 15' OF THE BASIN.

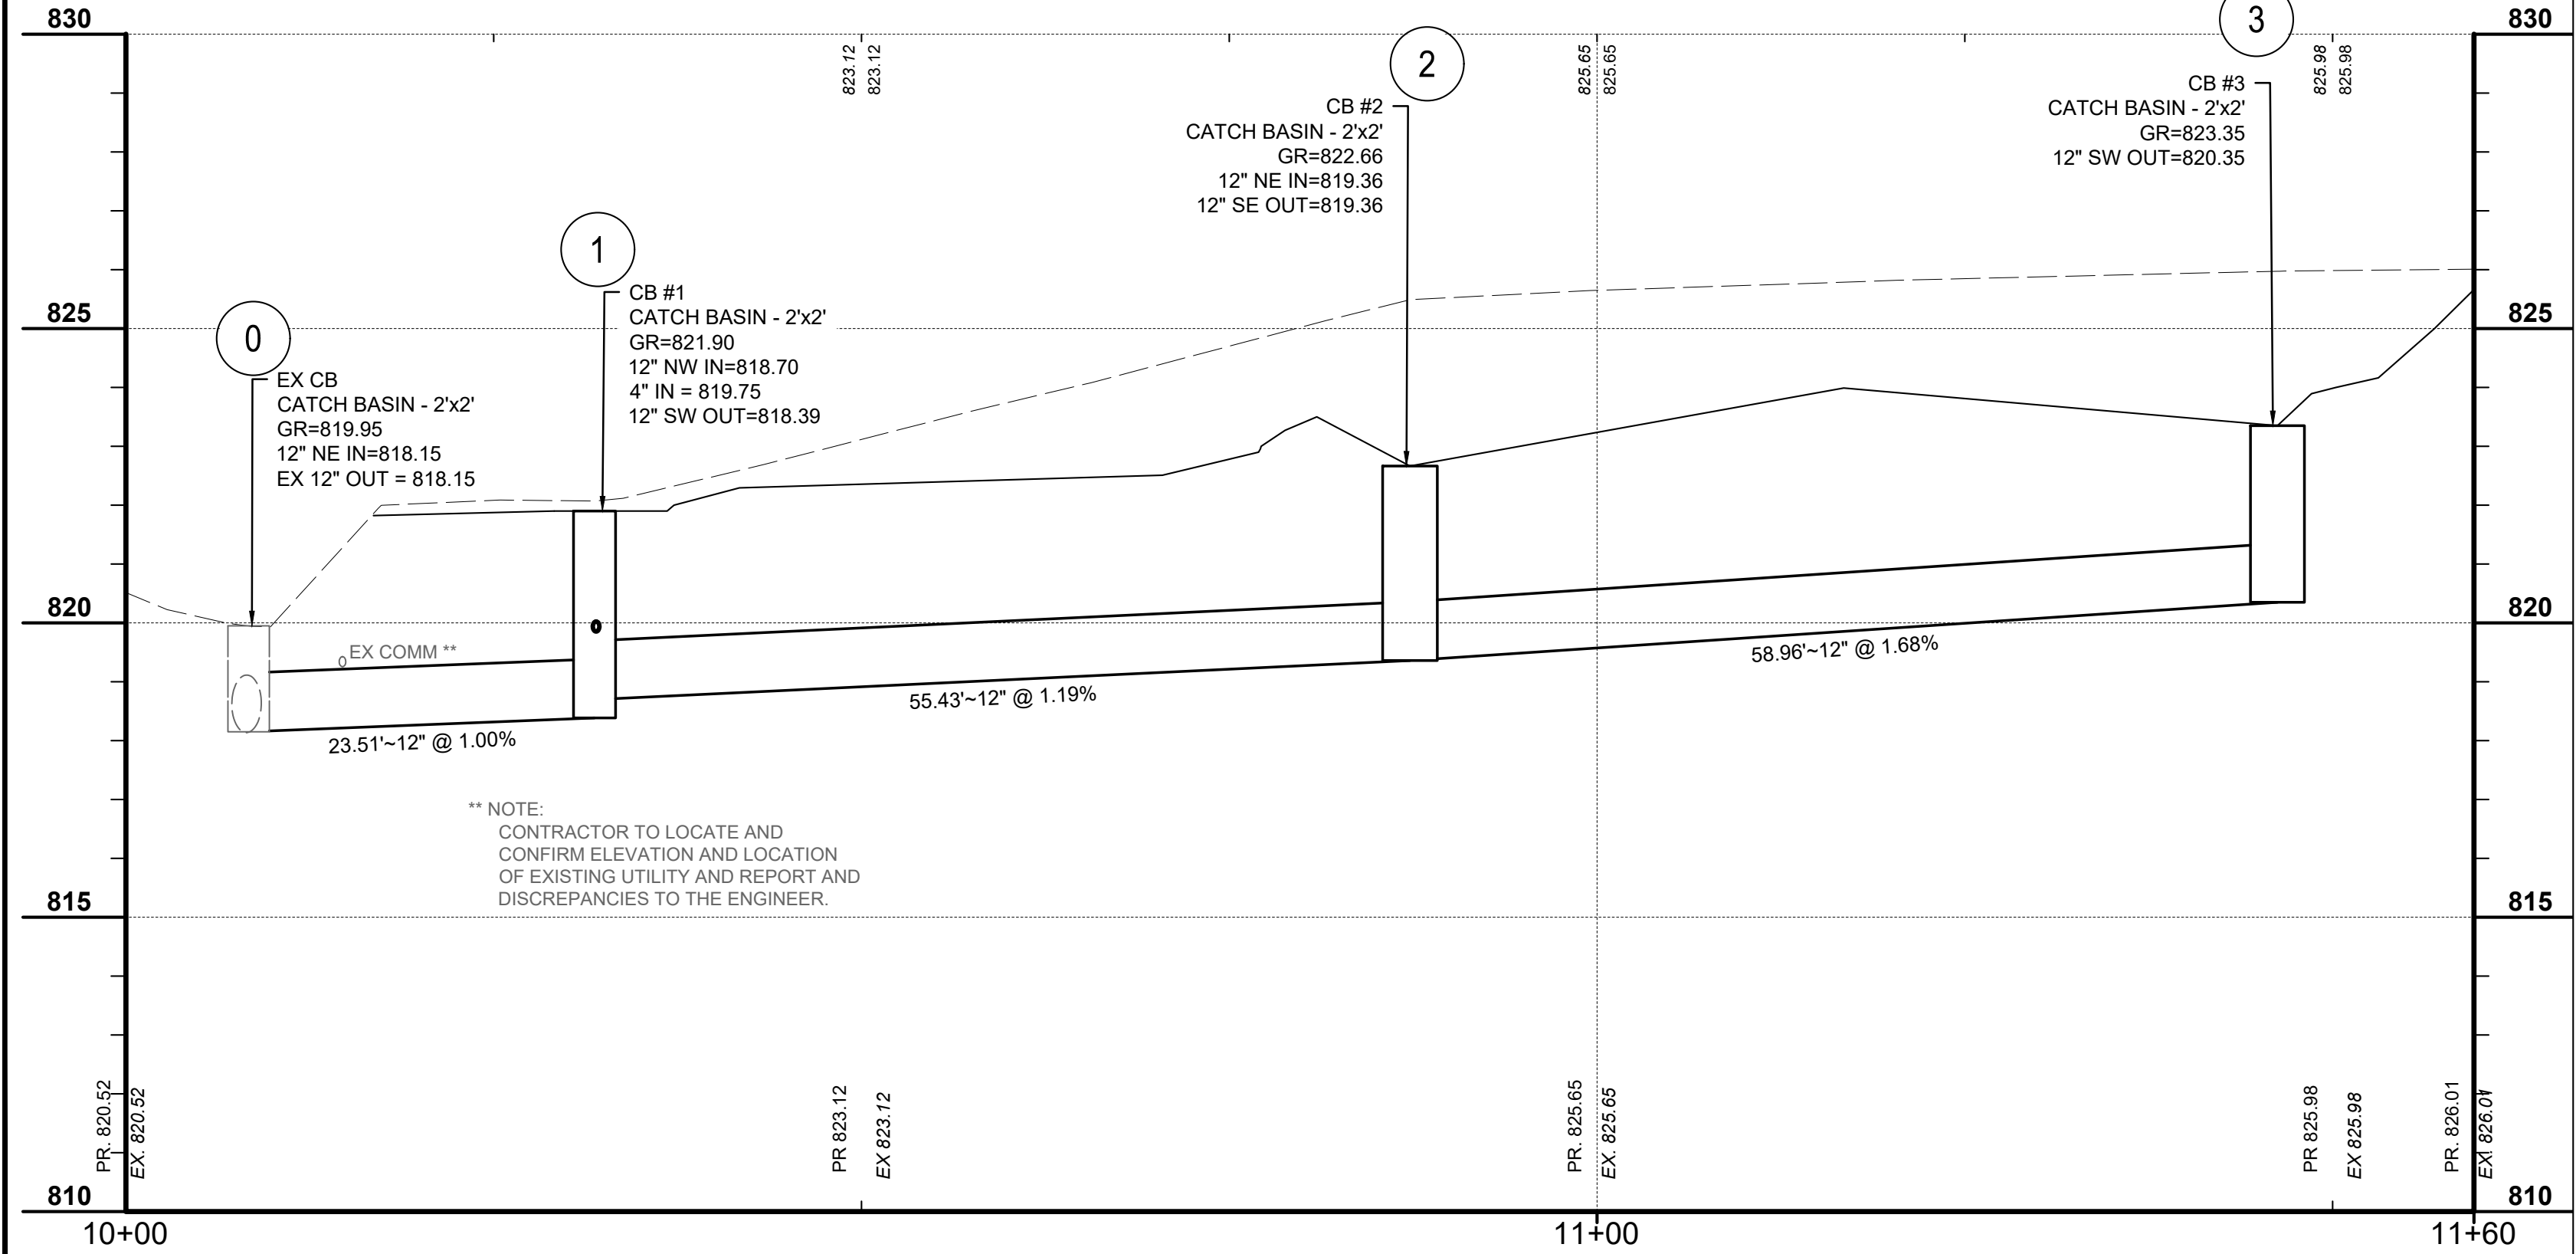

**\*\* NOTE:**  
CONTRACTOR TO LOCATE AND CONFIRM ELEVATION AND LOCATION OF EXISTING UTILITY AND REPORT AND DISCREPANCIES TO THE ENGINEER.

**PR STM1**





300 BUTTERMILK PIKE, SUITE 332  
FORT MITCHELL, KENTUCKY 41017  
TEL: (859) 525-0644  
WWW.VERDANTAS.COM

NO	REVISION	DATE

**115 KENNEDY PLAYGROUND**  
**SITE GRADING**  
**CITY OF FORT WRIGHT**  
**KENTON COUNTY, KY**

PROJECT NO.	39397
DISCIPLINE	CIVIL
SHEET NAME	DET1
SHEET	3
OF	7

DESIGNED BY: DGAR  
DRAWN BY: DGAR  
CHECKED BY: MHEL

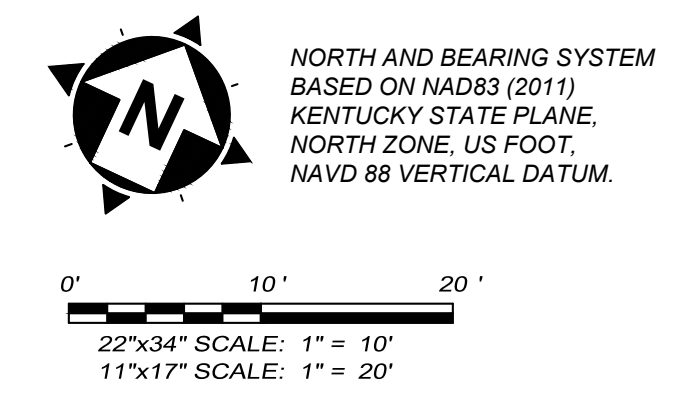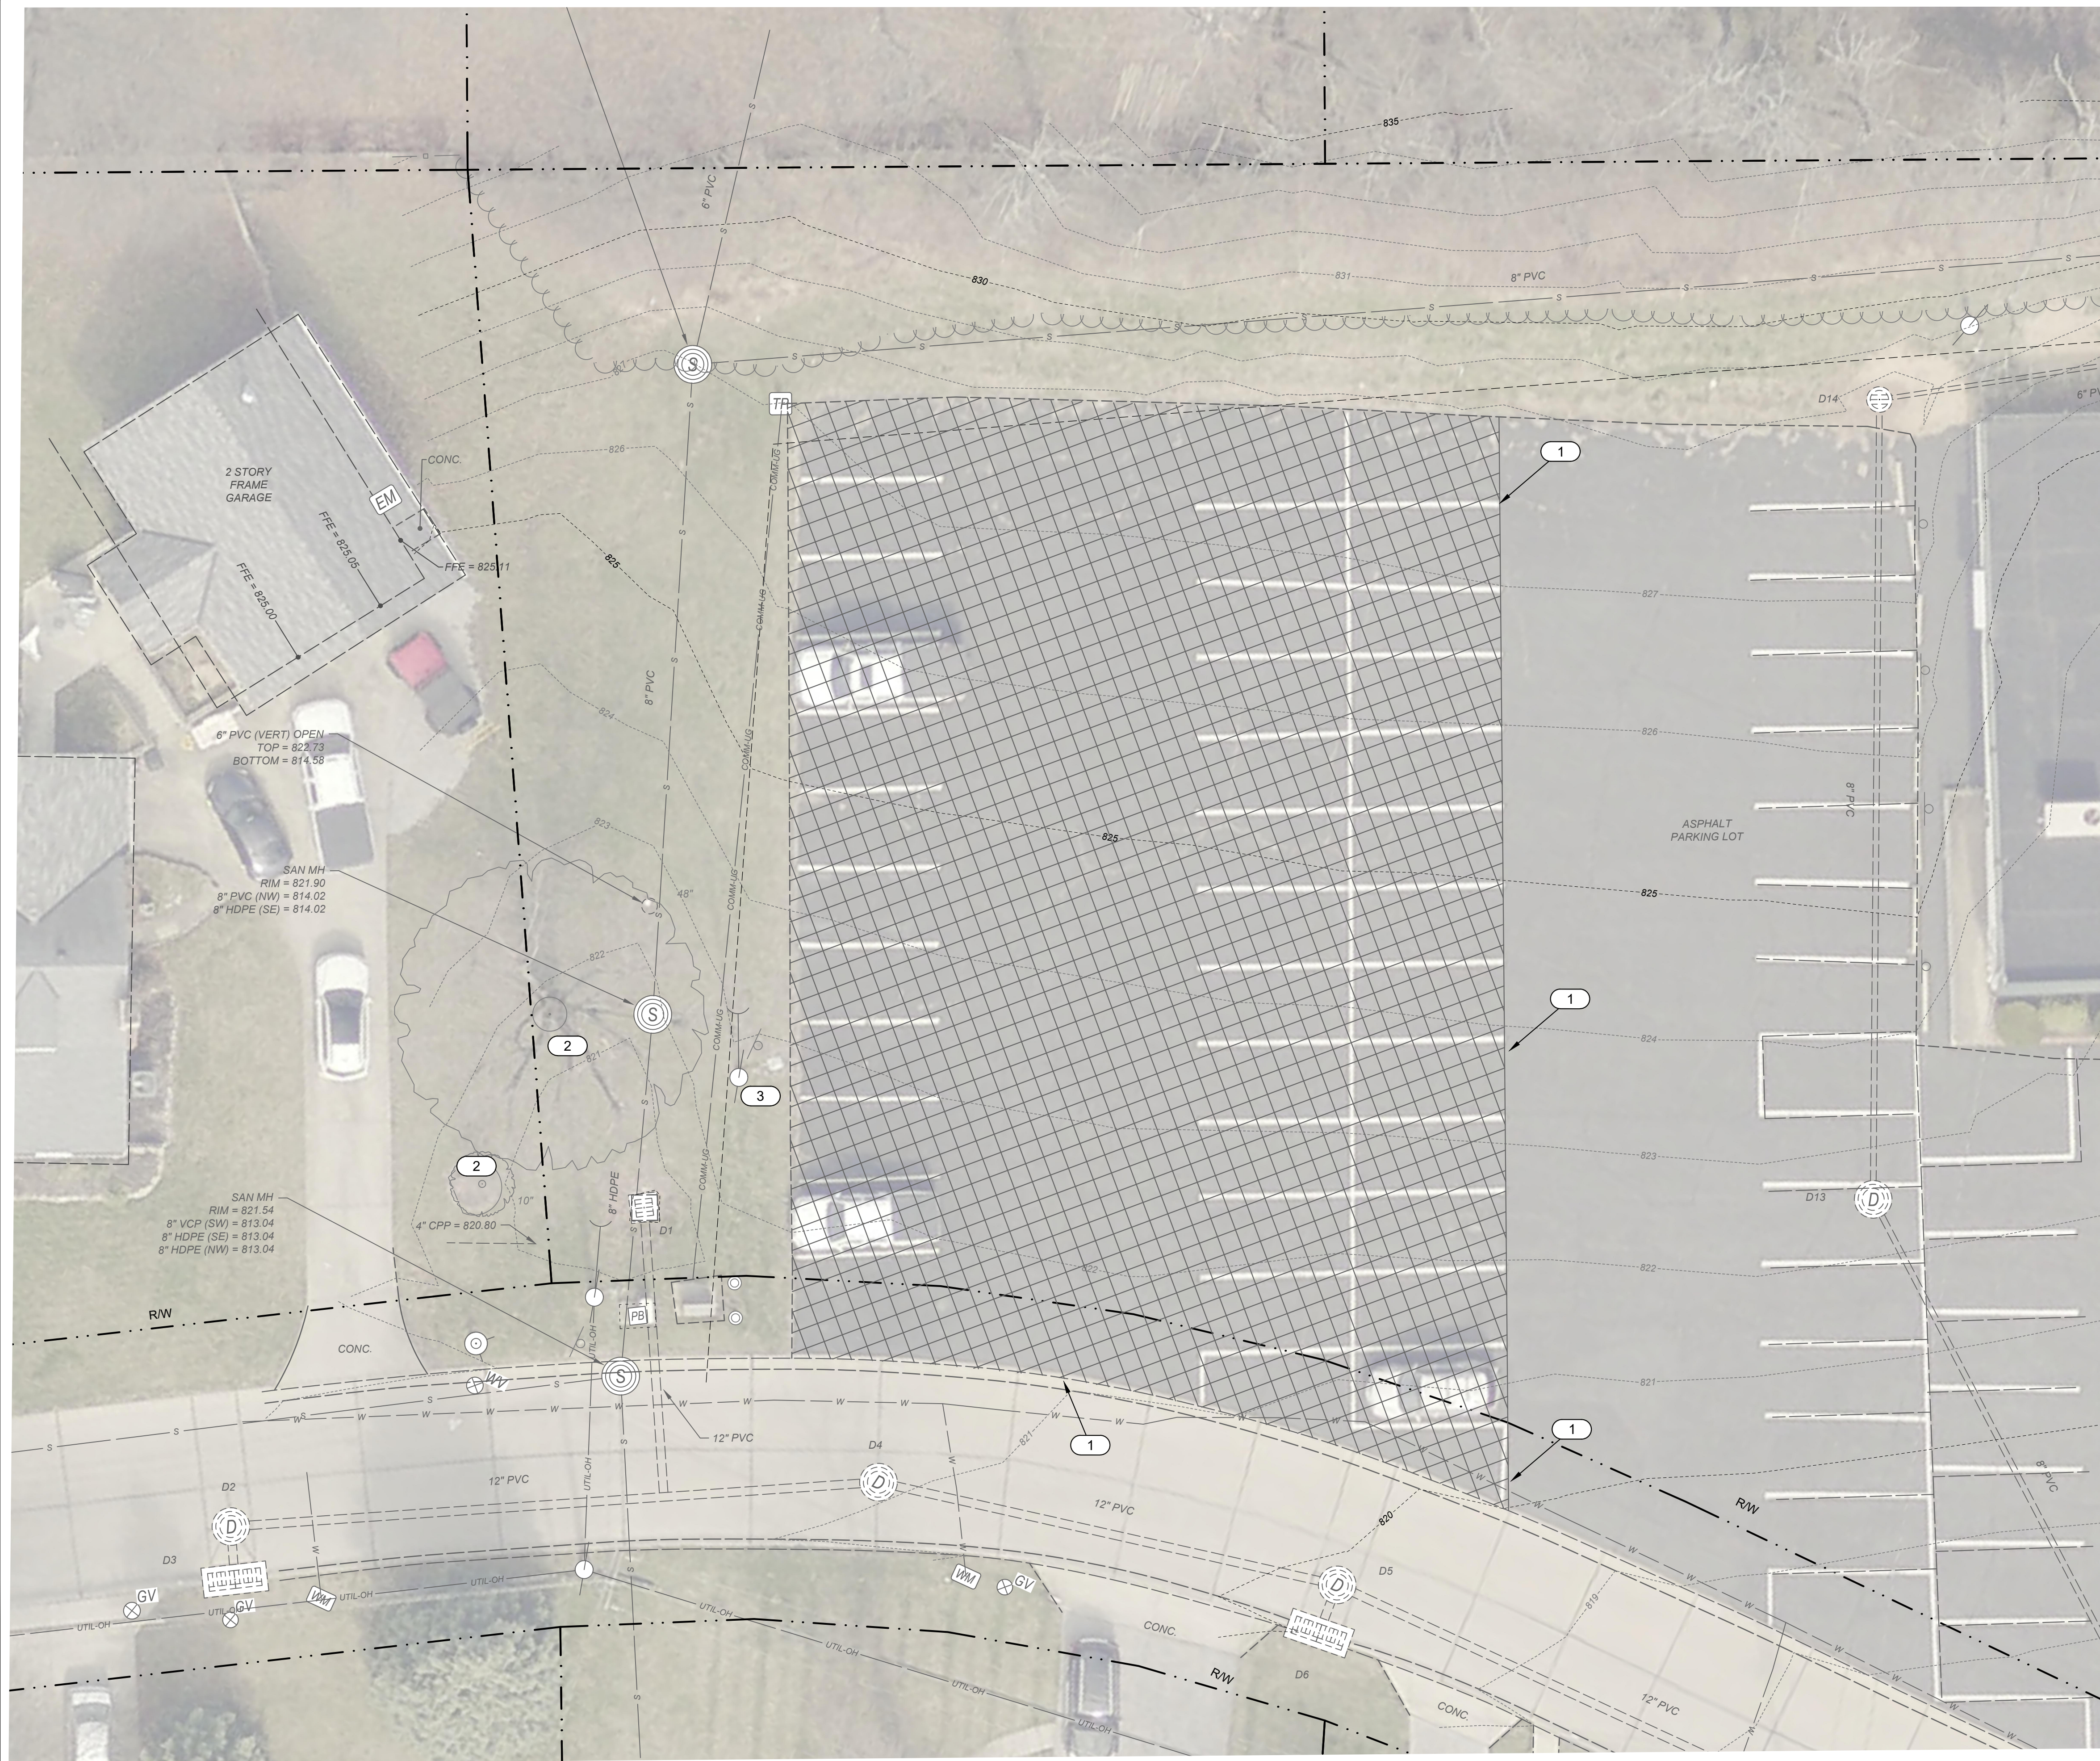

- DEMOLITION NOTES**
- 1 SAW-CUT AND REMOVE EXISTING CURB AND PAVEMENT FOR A CLEAN JOINT TO CONSTRUCT NEW PAVEMENT.
  - 2 PROTECT EXISTING TREES.
  - 3 REMOVE AND RELOCATE EXISTING SITE LIGHTING POLES, COORDINATE WORK WITH OWNER.



STORM STRUCTURES		STORM STRUCTURES	
D1	CB T/G = 819.95 12" PVC (S) = 818.15	D11	CURB INLET (DGI) T/G = 816.57 12" PVC (NW) = 811.62
D2	STM MH RIM = 821.73 12" PVC (NE) = 817.25 12" PVC (SE) = 817.41	D12	CURB INLET (DGI) T/G = 816.71 18" RCP (NE) = 808.91 18" RCP (S) = 808.91
D3	CURB INLET (DGI) T/G = 821.31 12" PVC (N) = 818.39	D13	STM MH RIM = 822.53 8" PVC (N) = 818.08 8" PVC (SE) = 818.08
D4	STM MH RIM = 821.04 12" PVC (NE) = 815.99 12" PVC (SW) = 815.99	D14	CB (ROUND) T/G = 827.25 6" PVC (E) = 823.50 8" PVC (S) = 821.25
D5	STM MH RIM = 819.82 12" PVC (SW) = 814.99 12" PVC (E) = 814.87 12" PVC (S) = 815.20	D15	CB T/G = 816.76 8" PVC (NW) = 814.21 18" RCP (NE) = 809.26 18" RCP (SW) 809.26
D6	CURB INLET (DGI) T/G = 819.41 12" PVC (N) = 815.39	D16	CB T/G = 816.68 8" VCP (E) = 813.83 18" RCP (NE) = 809.63 18" RCP (SW) 809.18
D7	STM MH RIM = 816.88 12" PVC (E) = 811.26 12" PVC (SE) = 811.33 12" PVC (W) = 811.43 18" RCP (N) = 808.33 18" RCP (S) = 808.33	D17	CB T/G = 816.92 6" PVC (NE) = 814.52 8" VCP (SW) = 814.42
D8	STM MH RIM = 807.42 18" RCP (N) = 801.93 18" RCP (S) = 801.93	D18	CB (DOME) T/G = 820.13 6" PVC (SW) (VERT) BOTTOM = 817.78
D9	STM MH RIM = 807.68 8" VCP (SE) = 804.61 18" RCP (N) = 802.56 18" RCP (S) = 802.56	D19	STM MH RIM = 817.15 12" PVC (N) = 813.25 12" PVC (S) = 813.10 12" PVC (W) = 813.10
D10	STM MH RIM = 815.35 18" RCP (NE) = 807.14 18" RCP (S) = 807.14	D20	CURB INLET (DGI) T/G = 816.85 12" PVC (S) = 813.32
		D21	CURB INLET (DGI) T/G = 816.90 12" PVC (N) = 813.05





ISSUED FOR:	BIDDING NO:	REVISION NO:	DATE:
ISSUE DATE: 05/28/2026	NO:	REVISION:	DATE:
SCALE: 1"=10'	DESIGNED BY: DGAR	DRAWN BY: DGAR	CHECKED BY: MHEL


**115 KENNEDY PLAYGROUND  
SITE GRADING  
CITY OF FORT WRIGHT  
KENTON COUNTY, KY**

**EXISTING CONDITION & DEMO PLAN**

PROJECT NO.	39397
DISCIPLINE	CIVIL
SHEET NAME	C01
SHEET	4
OF	7

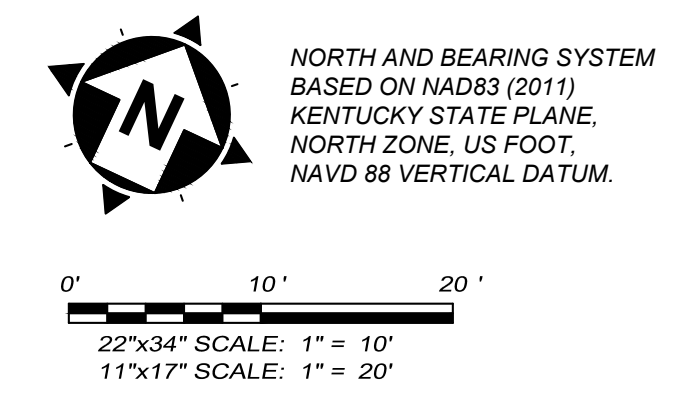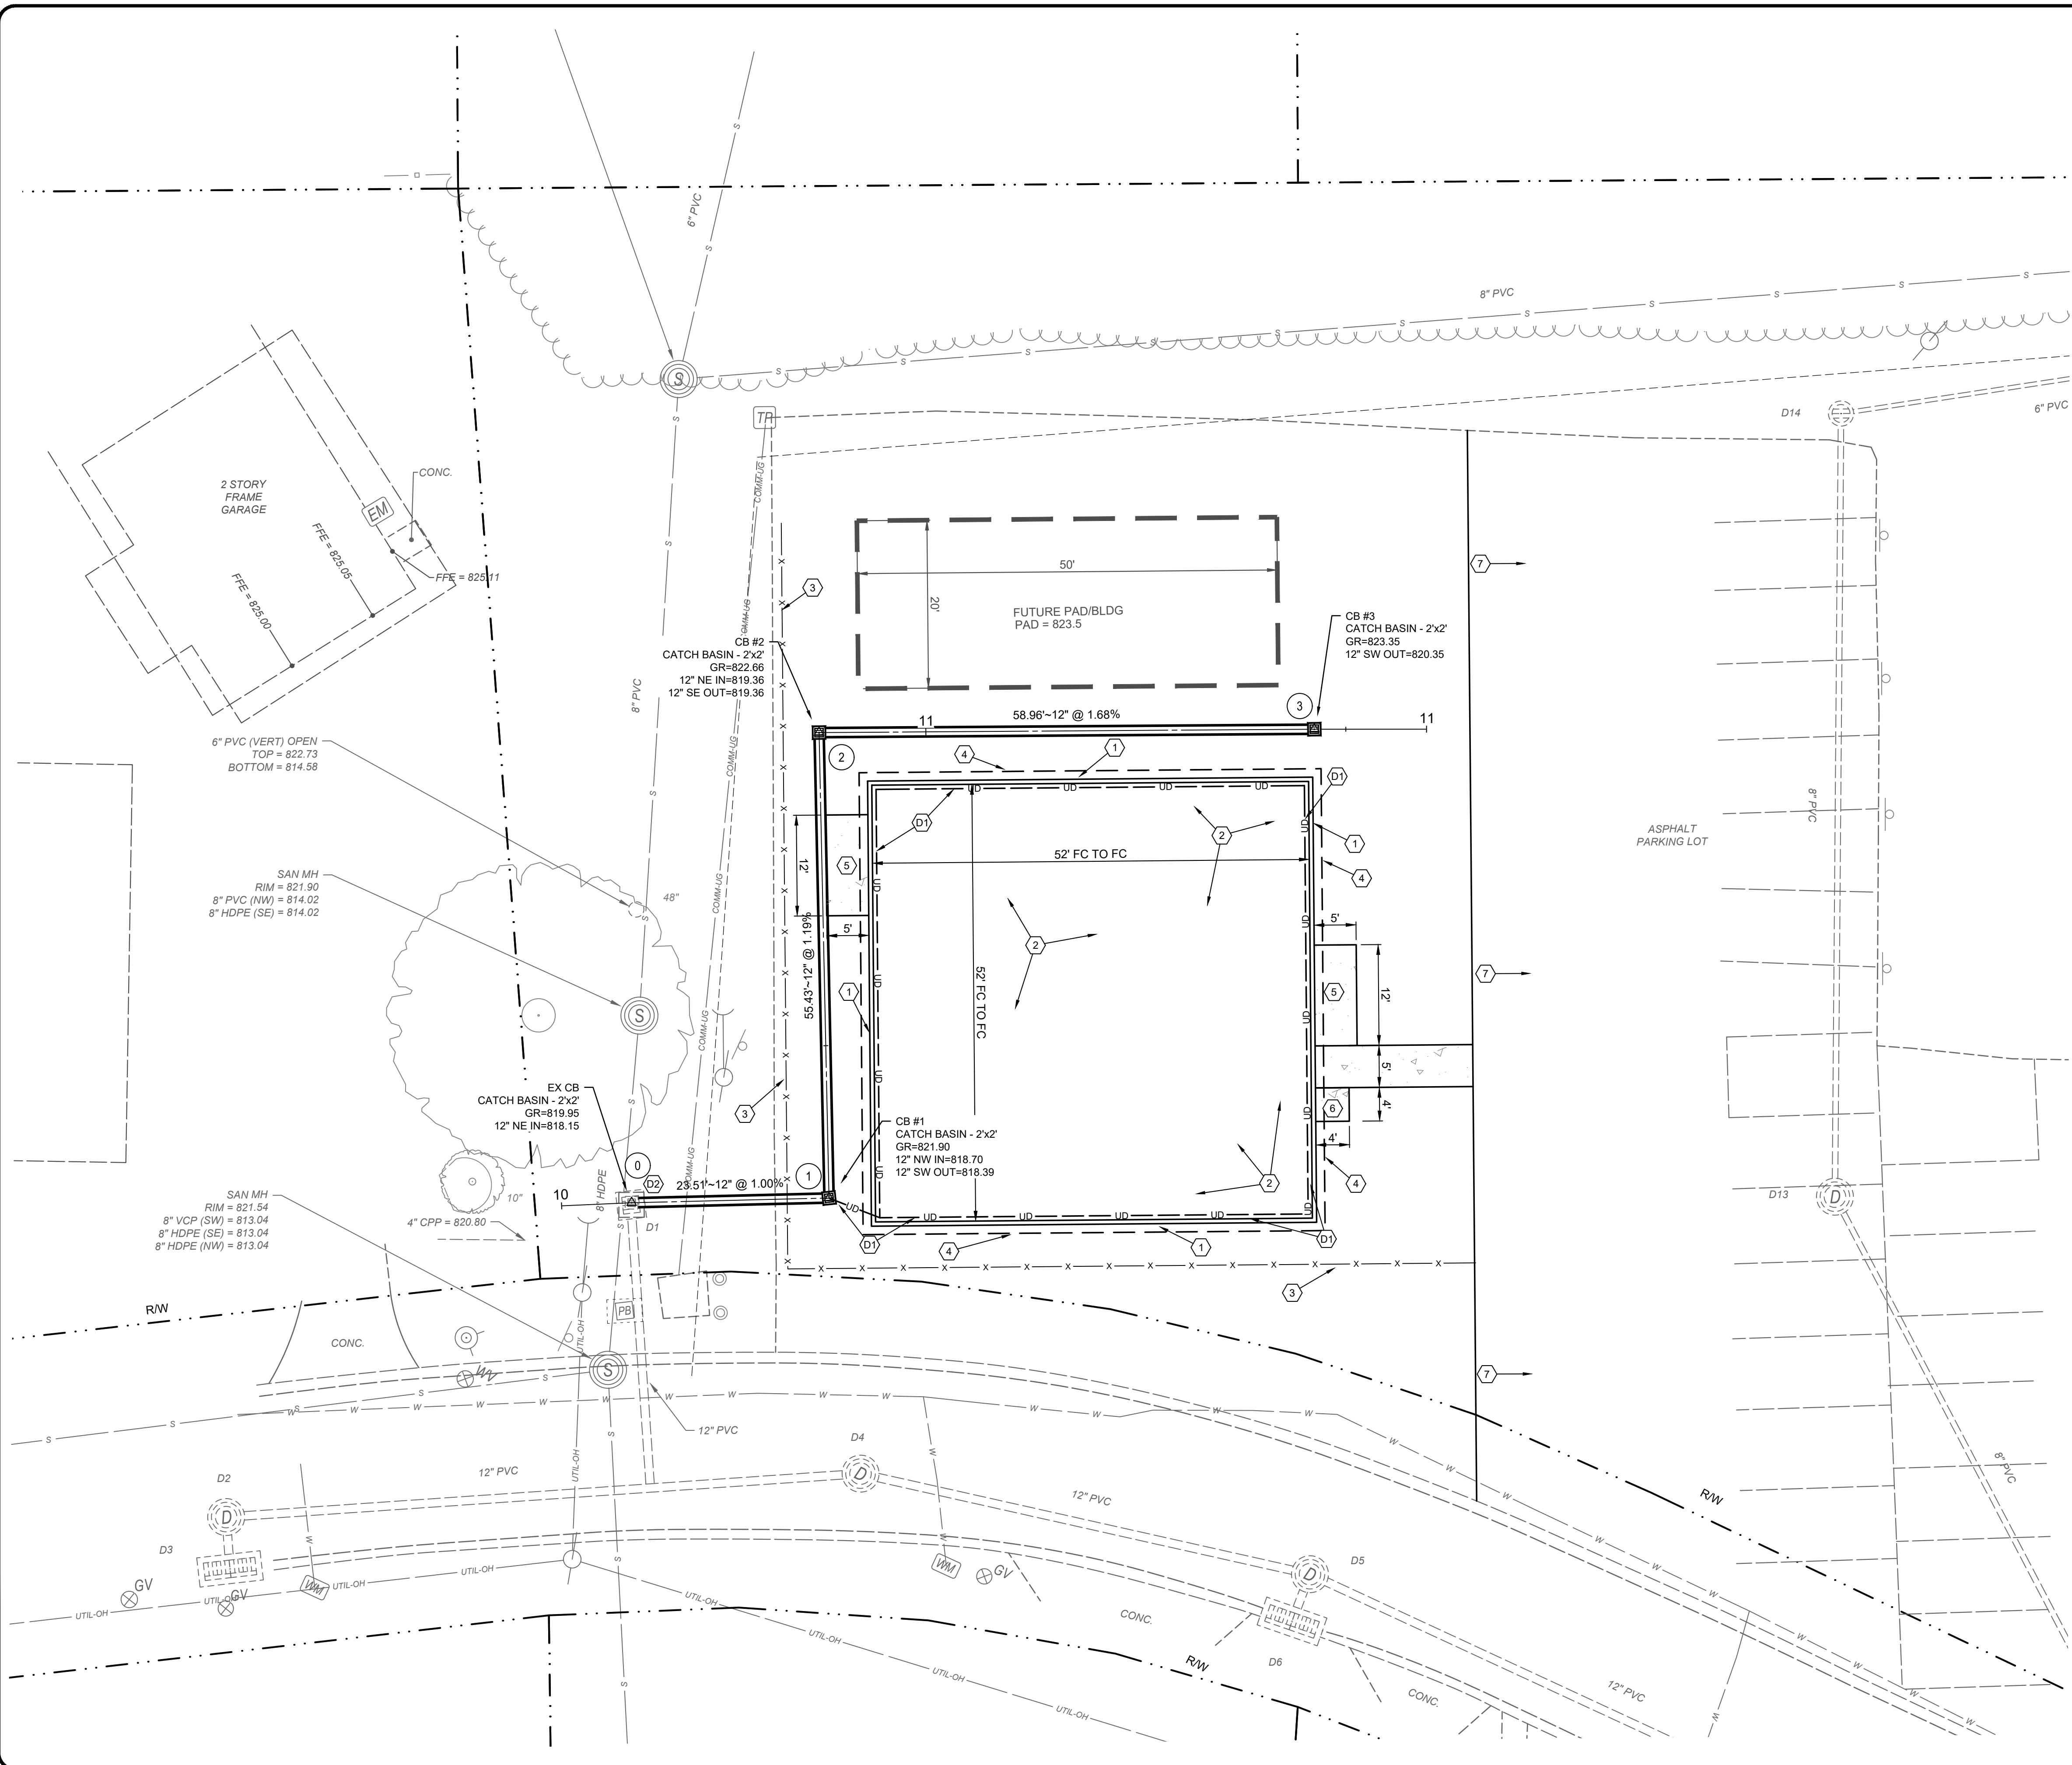

- GENERAL CONSTRUCTION NOTES**
- 1 CONSTRUCT CONCRETE VERTICAL CURB. SEE DETAIL SHEET
  - 2 PLAYGROUND AREA PER TYPICAL SECTION. SEE DETAIL SHEET.
  - 3 FUTURE FENCE (BY OTHERS).
  - 4 EDGE OF GRAVEL PAD 1' BEYOND BACK OF CURB.
  - 5 4" CONCRETE SIDEWALK FOR BENCH PAD.
  - 6 4" CONCRETE SIDEWALK FOR TRASH CAN PAD.
  - 7 EXISTING PAVEMENT TO REMAIN
- STORM SEWER CONSTRUCTION NOTES**
- D1 CONSTRUCT UNDERDRAIN PER TYPICAL SECTION AND AROUND THE PERIMETER OF PLAYGROUND AS SHOWN ON PLANS. CONNECT UNDERDRAIN TO PROPOSED CATCH BASIN.
  - D2 CONNECT PROPOSED STORM SEWER TO EXISTING CATCH BASIN. CORE DRILL AND PROVIDE BOOT CONNECTION TO EXISTING STRUCTURE.

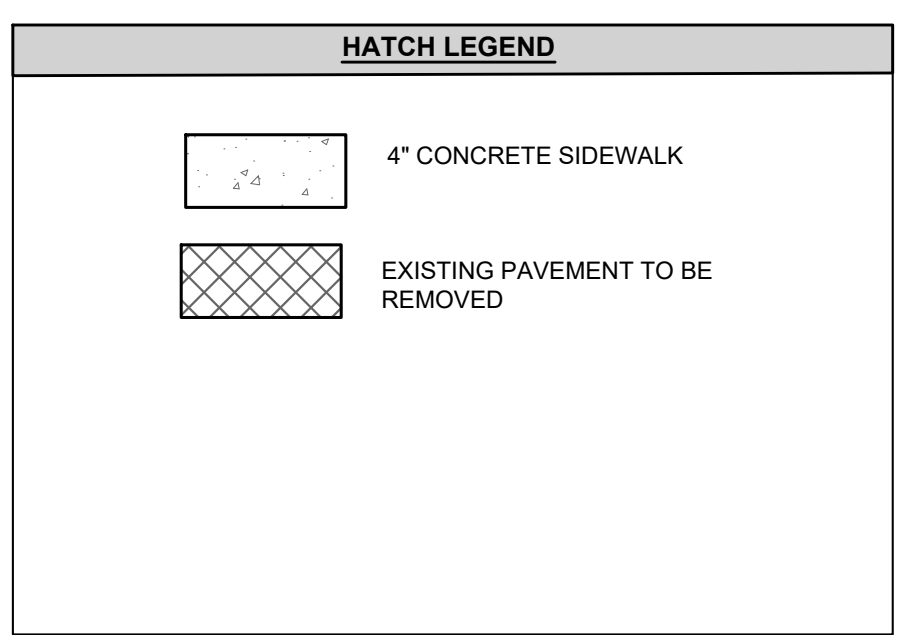

STORM STRUCTURES		STORM STRUCTURES	
D1	CB T/G = 819.95 12" PVC (S) = 818.15	D11	CURB INLET (DGI) T/G = 816.57 12" PVC (NW) = 811.62
D2	STM MH RIM = 821.73 12" PVC (NE) = 817.25 12" PVC (SE) = 817.41	D12	CURB INLET (DGI) T/G = 816.71 18" RCP (NE) = 808.91 18" RCP (S) = 808.91
D3	CURB INLET (DGI) T/G = 821.31 12" PVC (N) = 818.39	D13	STM MH RIM = 822.53 8" PVC (N) = 818.08 8" PVC (SE) = 818.08
D4	STM MH RIM = 821.04 12" PVC (NE) = 815.99 12" PVC (SW) = 815.99	D14	CB (ROUND) T/G = 827.25 6" PVC (E) = 823.50 8" PVC (S) = 821.25
D5	STM MH RIM = 819.82 12" PVC (SW) = 814.99 12" PVC (E) = 814.87 12" PVC (S) = 815.20	D15	CB T/G = 816.76 8" PVC (NW) = 814.21 18" RCP (NE) = 809.26 18" RCP (SW) 809.26
D6	CURB INLET (DGI) T/G = 819.41 12" PVC (N) = 815.39	D16	CB T/G = 816.68 8" VCP (E) = 813.83 18" RCP (NE) = 809.63 18" RCP (SW) 809.18
D7	STM MH RIM = 816.88 12" PVC (E) = 811.26 12" PVC (SE) = 811.33 12" PVC (W) = 811.43 18" RCP (N) = 808.33 18" RCP (S) = 808.33	D17	CB T/G = 816.92 6" PVC (NE) = 814.52 8" VCP (SW) = 814.42
D8	STM MH RIM = 807.42 18" RCP (N) = 801.93 18" RCP (S) = 801.93	D18	CB (DOME) T/G = 820.13 6" PVC (SW) (VERT) BOTTOM = 817.78
D9	STM MH RIM = 807.68 8" VCP (SE) = 804.61 18" RCP (N) = 802.56 18" RCP (S) = 802.56	D19	STM MH RIM = 817.15 12" PVC (N) = 813.25 12" PVC (S) = 813.10 12" PVC (W) = 813.10
D10	STM MH RIM = 815.35 18" RCP (NE) = 807.14 18" RCP (S) = 807.14	D20	CURB INLET (DGI) T/G = 816.85 12" PVC (S) = 813.32
		D21	CURB INLET (DGI) T/G = 816.90 12" PVC (N) = 813.05



ISSUED FOR:	BIDDING NO:	DATE:	REVISION NO:	DATE:
ISSUE DATE:	05/28/2026			
SCALE:	1"=10'			
DESIGNED BY:	DGAR			
DRAWN BY:	DGAR			
CHECKED BY:	MHEL			

**115 KENNEDY PLAYGROUND**  
**SITE GRADING**  
 CITY OF FORT WRIGHT  
 KENTON COUNTY, KY




**SITE & UTILITY PLAN**

PROJECT NO.  
**39397**

DISCIPLINE  
**CIVIL**

SHEET NAME  
**C02**

SHEET **5** OF **7**

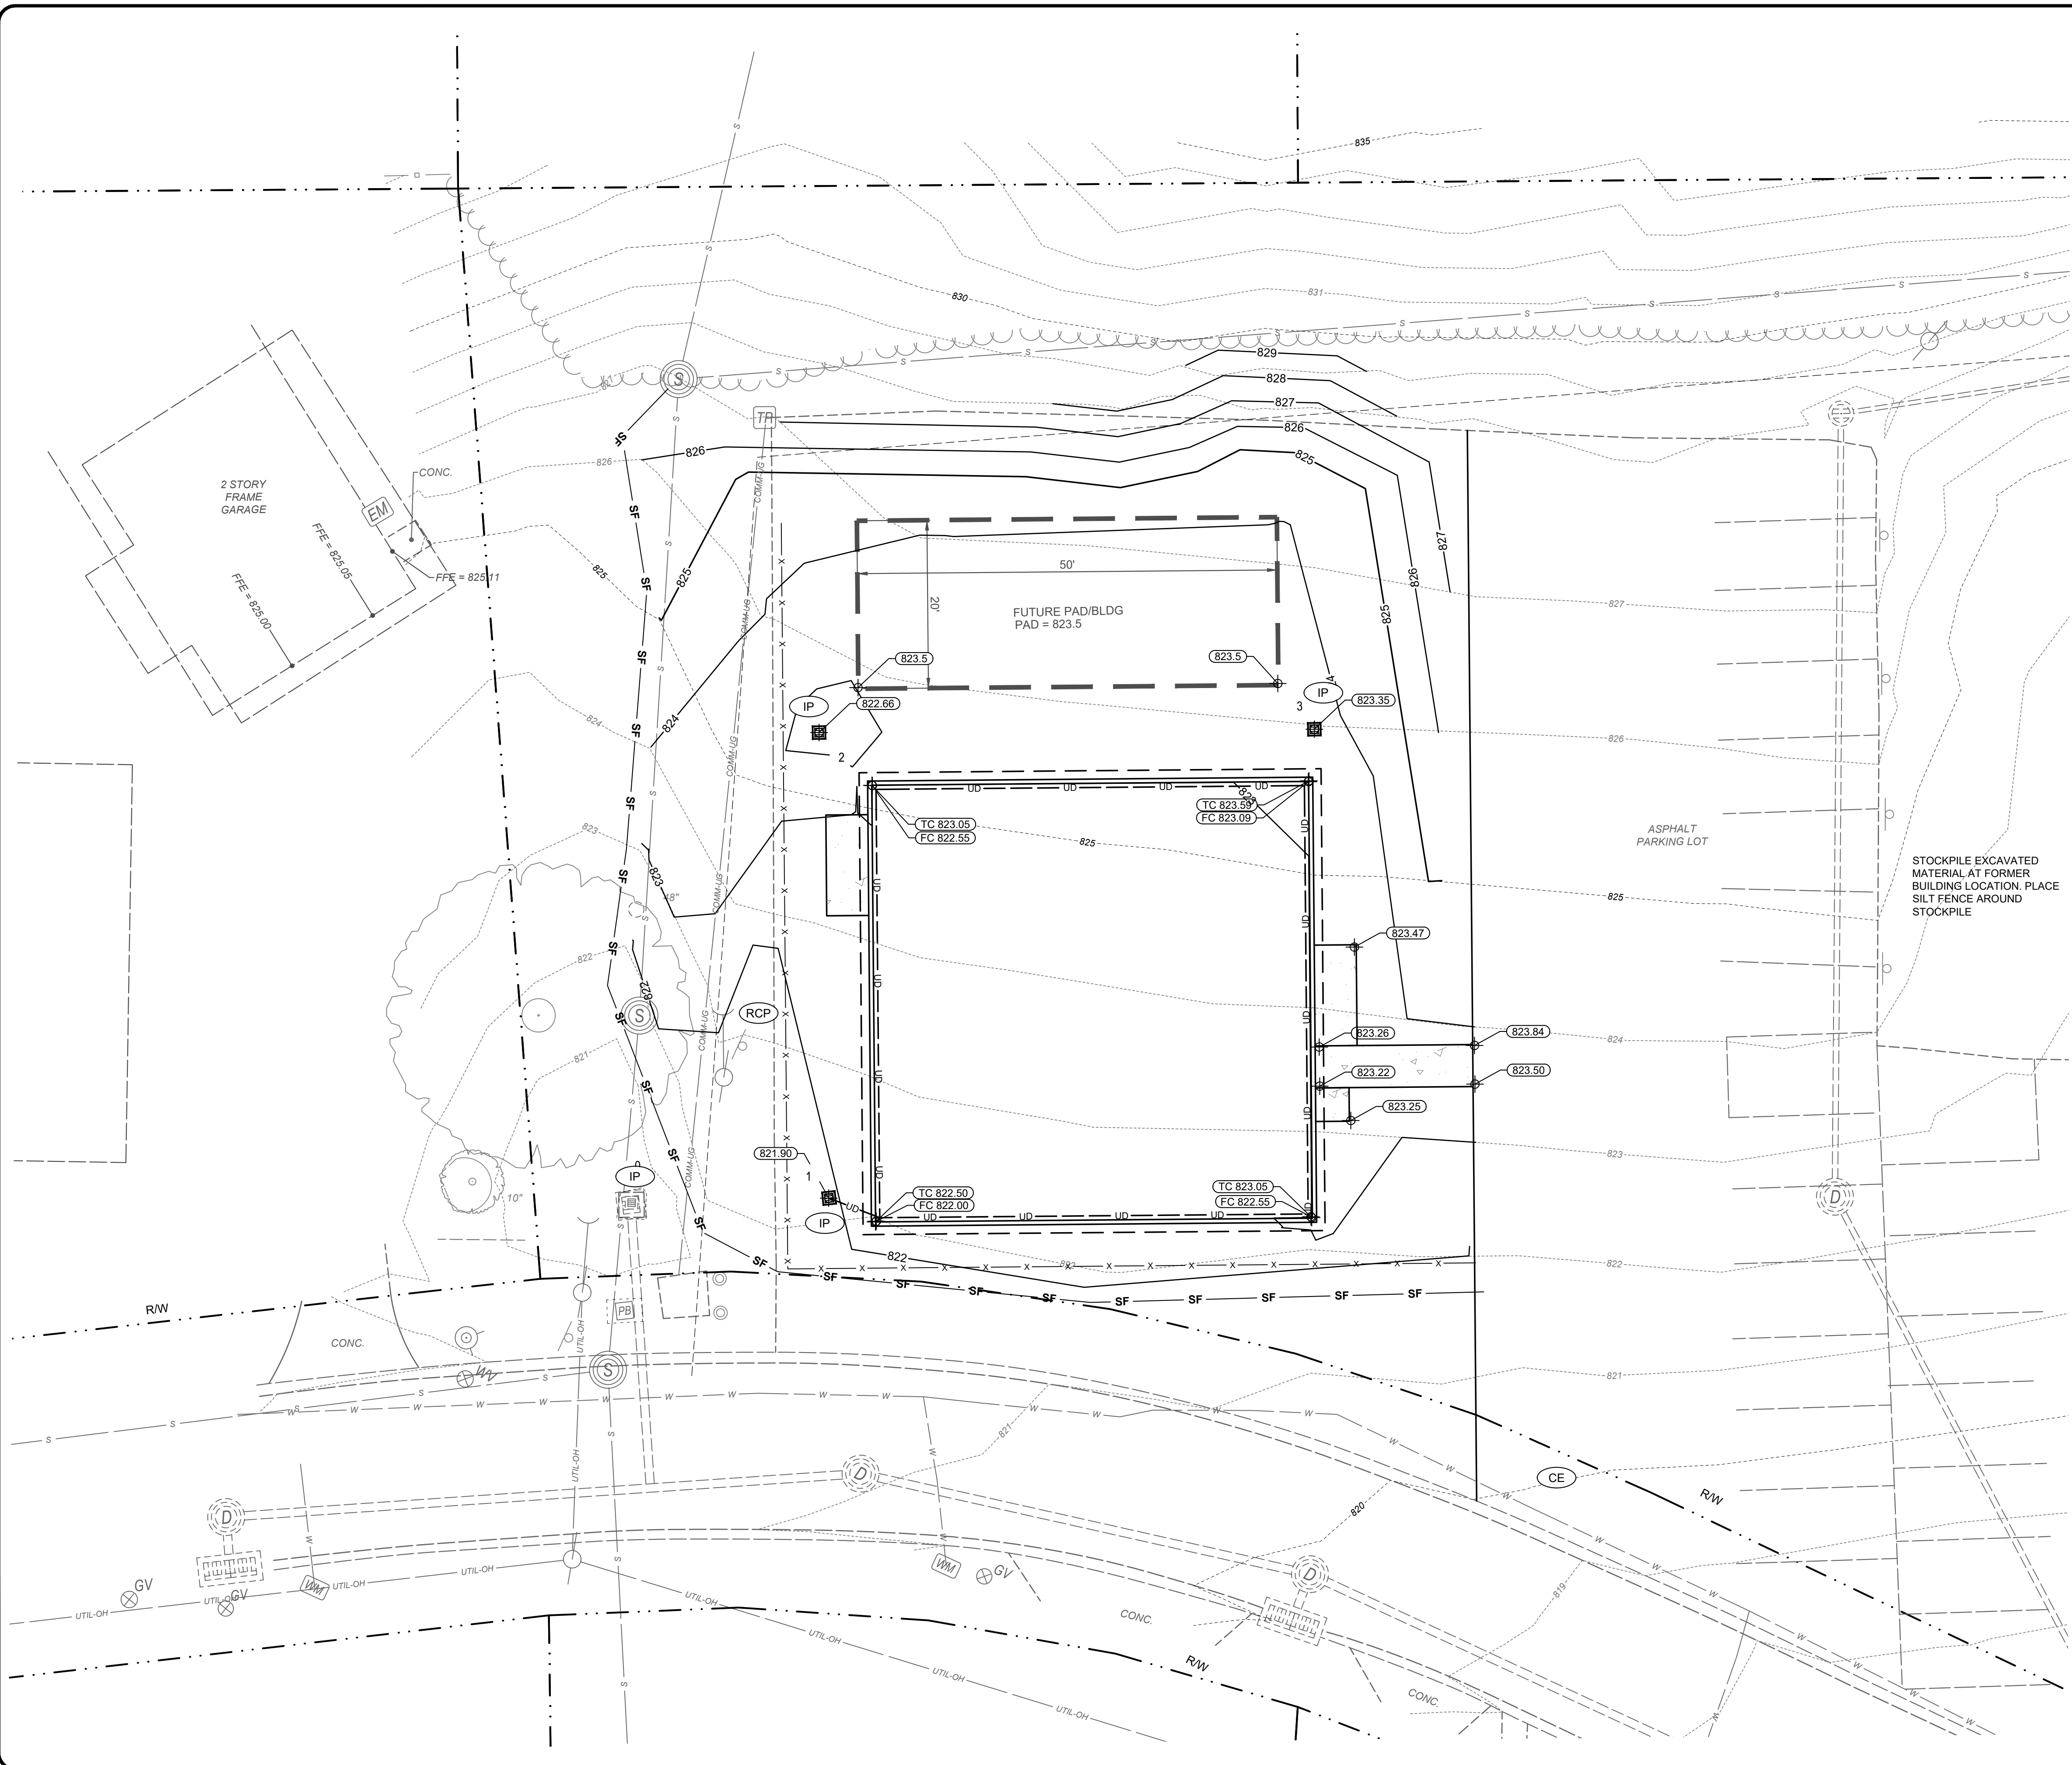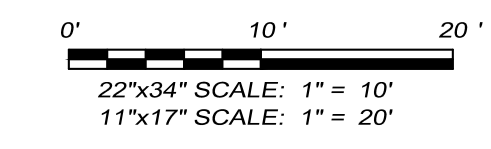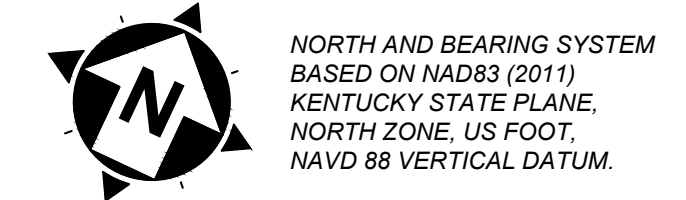

**EROSION CONTROL LEGEND**

- INLET PROTECTION (SEE DETAIL)
- CONSTRUCTION ENTRANCE
- ROCK CHANNEL PROTECTION
- PROPOSED SILT FENCE

**GRADING LEGEND**

- EXISTING SPOT ELEVATION EX 232.46
- PROPOSED SPOT ELEVATION 232.60
- PROPOSED SPOT ELEVATION (TRUNCATED) GR 32.60
- PROPOSED SPOT ELEVATION AT TOP/BACK OF CURB TC 232.60
- PROPOSED SPOT ELEVATION AT FACE/BOTTOM OF CURB FC 232.60
- PROPOSED SPOT ELEVATION AT TOP/BACK OF WALL TW 232.60
- PROPOSED SPOT ELEVATION AT FACE/BOTTOM OF WALL FW 232.60
- PROPOSED SPOT ELEVATION AT HIGH POINT HP 232.60
- PROPOSED SPOT ELEVATION AT LOW POINT LP 232.60
- PROPOSED SPOT ELEVATION AT STRUCTURE GRATE GR 232.60
- PROPOSED GRADE LABEL 10.8%
- PROPOSED SLOPE LABEL 4:1
- PROPOSED GRADE BREAK GRADE BREAK
- PROPOSED GRADING VALLEY VALLEY
- DIRECTION OF FLOW



300 BUTTERMILK PIKE, SUITE 332  
FORT MITCHELL, KENTUCKY 41017  
TEL: (609) 525-0644  
WWW.VERDANTAS.COM

NO	REVISION	DATE

ISSUED FOR:	BIDDING	NO	
ISSUE DATE:	05/28/2026		
SCALE:	1"=10'	DGAR	
DESIGNED BY:		DGAR	
DRAWN BY:		MHEL	
CHECKED BY:			

**115 KENNEDY PLAYGROUND  
SITE GRADING  
CITY OF FORT WRIGHT  
KENTON COUNTY, KY**

**GRADING AND EROSION PLAN**

PROJECT NO.	<b>39397</b>
DISCIPLINE	<b>CIVIL</b>
SHEET NAME	<b>C03</b>
SHEET	<b>6</b>
OF	<b>7</b>


Z:\PROJECT FILES\A\FORT WRIGHT\39397 - FORT WRIGHT COMMUNITY CENTER\DWG\BASE\C\_39397 - P-BASE.DWG - GRADING - 5/27/2026 3:20:15 PM - DAVE GARRETT

**STORM WATER POLLUTION PREVENTION NOTES**

- SANITATION DISTRICT NO. 1 IS TO BE CONTACTED 72 HOURS PRIOR TO ANY CONSTRUCTION ACTIVITY AT 859-578-6892
- ALL EROSION AND SEDIMENTATION CONTROL SHALL BE PERFORMED AS SHOWN ON THE PLANS, AND SHALL BE IN COMPLIANCE WITH THE LATEST CONSTRUCTION ACTIVITY NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM RULES AND REGULATIONS AND SECTION 02370 OF SD1 SPECIFICATIONS.
- A COPY OF THE STORM WATER POLLUTION PREVENTION PLAN (SWPPP) AND A COPY OF THE "NOTICE OF INTENT" (NOI) SHALL BE KEPT ON SITE.
- AN AMENDMENT OF THE SWPPP IS REQUIRED WHENEVER A CHANGE IN DESIGN, CONSTRUCTION, AND OPERATION OR MAINTENANCE HAS A SIGNIFICANT EFFECT ON THE POTENTIAL FOR THE DISCHARGE OF POLLUTANTS, OR IF THE SWPPP PROVES TO BE INEFFECTIVE IN ACHIEVING THE GENERAL OBJECTIVES OF THE SWPPP.
- THE CONTRACTOR SHALL ALSO MAINTAIN THE FOLLOWING RECORDS ON SITE:
  - GENERAL CONTRACTOR AND/OR SUBCONTRACTOR SWPPP CERTIFICATIONS
  - THE DATE, TIME, AND EXACT LOCATION OF THE INSPECTION, AND THE NAME OF THE INSPECTOR
  - AN ASSESSMENT OF THE CONDITION OF THE EROSION CONTROLS
  - A DESCRIPTION OF ANY EROSION CONTROL IMPLEMENTATION AND MAINTENANCE PERFORMED
  - A DESCRIPTION OF THE PRESENT PHASE OF CONSTRUCTION AT THE SITE
- CONSTRUCTION SEQUENCE
  - ALL PERIMETER SILT FENCE, INLET PROTECTION AND OTHER EROSION CONTROLS SHALL BE IN PLACE BEFORE ANY OTHER EARTH MOVING ACTIVITIES BEGIN.
  - THE CONTRACTOR SHALL CLEAR AND GRUB ONLY THE AREAS PLANNED FOR EARTH MOVING.
  - REMOVE TOPSOIL, STOCKPILE IT, AND INSTALL SILT FENCE AROUND PERIMETER.
  - SEED SOIL STOCKPILE WITH PERENNIAL RYE GRASS AND MULCH WITH STRAW IF NO TO BE DISTURBED FOR MORE THAN 21 DAYS.
  - INSTALL STORM SEWER SYSTEM AND SURFACE STORM INLET AND MANHOLE PROTECTION WHERE REQUIRED.
  - ESTABLISH A TEMPORARY SEEDING ON ALL BARE AREAS THAT ARE TO REMAIN UNDISTURBED FOR MORE THAN 21 DAYS. SEED WITH PERENNIAL RYE GRASS MULCH WITH STRAW.
  - IMMEDIATE AFTER TOPSOIL HAS BEEN PLACED, STABILIZE THE SAME SURFACE AREA WITH FINAL SEED AND MULCH 7 DAYS AFTER REACHING FINAL GRADE.
  - AFTER THE VEGETATION HAS BECOME WELL ESTABLISHED, REMOVE TEMPORARY EROSION OR SEDIMENT CONTROL PRACTICES.
- EROSION CONTROLS MUST BE INSPECTED ONCE EVERY 7 DAYS AND WITHIN 24 HOURS OF 0.5" OR GREATER RAINFALL. REMOVE ACCUMULATED SEDIMENT FROM EROSION CONTROLS.
- TEMPORARY SEEDING SHALL BE PERENNIAL RYE GRASS (40 LB / ACRE) AND MULCH AT 3 BALES OF STRAW PER 1000 S.F.
- CONTRACTOR IS RESPONSIBLE FOR OBTAINING BORROW MATERIAL ONSITE AND / OR DISPOSING OF EXCESS MATERIAL OFF SITE AS REQUIRED TO MEET INDICATED DESIGN ELEVATIONS.
- DEBRIS SHALL BE COLLECTED WITHIN PROPERTY LIMITS WEEKLY OR AS NEEDED FOR PUBLIC SAFETY. SURROUNDING STREETS AFFECTED BY THE CONSTRUCTION SHALL BE CLEANED DAILY OR AS NEEDED FOR PUBLIC SAFETY. SEE CONSTRUCTION ENTRANCE DETAIL IN SWPPP DETAILS SHEET.
- THE CONSTRUCTION OF BMPs SHALL BE REVISED OR ADDED IF DEEMED NECESSARY PER SECTION 1000 OF THE SANITATION DISTRICT 1 REGULATIONS.
- CONTACT SANITATION DISTRICT NO. 1 72 HOURS PRIOR TO INSTALLATION OF THE WATER QUALITY FEATURE.

**NOTES:**

- SUBSOILING SHALL OCCUR WHEN SOIL MOISTURE IS LOW ENOUGH TO ALLOW THE SOIL TO CRACK OR FRACTURE. SUBSOILING IS NOT PERMITTED ON SLIP-PRONE AREAS.
- THE SITE SHALL BE GRADED TO PERMIT THE USE OF CONVENTIONAL EQUIPMENT FOR SEEDBED PREPARATION AND SEEDING.
- TOPSOIL SHALL BE APPLIED WHERE NEEDED TO ESTABLISH VEGETATION.
- THE SEEDBED SHALL BE PREPARED BY APPLYING AGRICULTURAL GROUND LIMESTONE OR FERTILIZER AS RECOMMENDED BY A SOIL TEST. IN LIEU OF A SOIL TEST, APPLY LIME AT 2 TONS/AC, OR FERTILIZER AT 500 LB/AC, OF 10-10-10 OR 12-12-12 ANALYSIS. LIME AND FERTILIZER SHALL BE WORKED INTO THE SOIL TO A DEPTH OF 3".
- APPLY SEED UNIFORMLY ON FIRM, MOIST SEED BED.
- SEEDING SHOULD BE APPLIED FROM MARCH 1 TO MAY 31 OR AUGUST 1 TO SEPTEMBER 30. IF SEEDING OCCURS OUTSIDE OF THESE DATES, ADDITIONAL MULCH AND IRRIGATION MAY BE REQUIRED TO ENSURE A MINIMUM OF 80% GERMINATION. TILLAGE FOR SEEDBED PREPARATION SHALL OCCUR WHEN THE SOIL IS DRY ENOUGH TO CRUMBLE AND NOT FORM RIBBONS WHEN COMPRESSED BY HAND.
- SEEDING SHOULD NOT BE APPLIED FROM OCTOBER 1 TO NOVEMBER 20 BECAUSE SEEDS MAY GERMINATE BUT WILL NOT SURVIVE THE WINTER. USE THE FOLLOWING METHODS FOR DORMANT SEEDING:
  - FROM OCTOBER 1 TO NOVEMBER 20, INCREASE THE SEEDING RATE BY 50%, PREPARE THE SEED BED, ADD LIME AND FERTILIZER, MULCH AND ANCHOR.
  - FROM NOVEMBER 20 TO MARCH 15, ONLY IF SOIL CONDITIONS PERMIT, INCREASE THE SEEDING RATE BY 50%, PREPARE THE SEED BED, ADD LIME AND FERTILIZER, APPLY THE SEED MIXTURE, MULCH AND ANCHOR.
- APPLY MULCH MATERIAL IMMEDIATELY AFTER SEEDING.
- PERMANENT SEEDING SHALL INCLUDE IRRIGATION TO ESTABLISH VEGETATION DURING DRY OR HOT WEATHER OR ON ADVERSE SITE CONDITIONS AS NEEDED. AVOID EXCESSIVE IRRIGATION AND MONITOR TO PREVENT EROSION AND DAMAGE FROM RUNOFF.
- PERMANENT SEEDING SHALL NOT BE CONSIDERED ESTABLISHED FOR AT LEAST 1 FULL YEAR FROM THE TIME OF PLANTING. DURING THIS PERIOD, INSPECT FOR SOIL EROSION OR PLANT LOSS AND REPAIR BARE OR SPARSE AREAS, FILL GULLIES, RE-FERTILIZE, RE-SEED OR RE-MULCH AS NEEDED.
- A MINIMUM OF 70% GROWTH DENSITY, BASED ON A VISUAL INSPECTION, MUST EXIST FOR AN ADEQUATE PERMANENT VEGETATIVE PLANTING.
- ALL SEEDING MIX, FERTILIZER AND MULCH SHALL CONFORM TO SECTION 02370 OF THE SANITATION DISTRICT No. 1 SPECIFICATIONS.

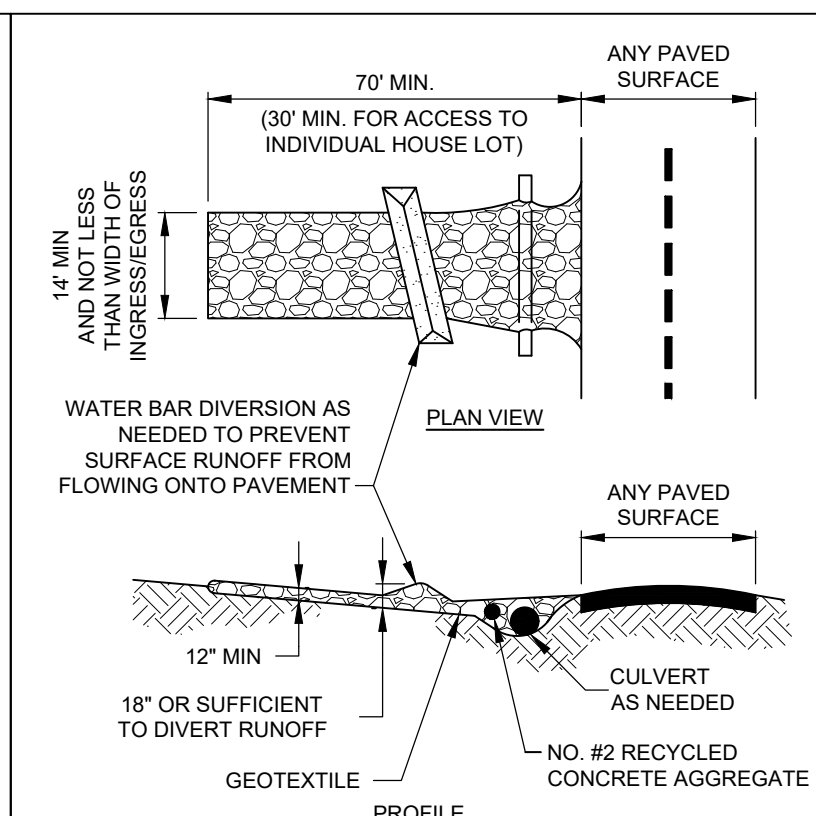

**NOTES:**

- PLACE GEOTEXTILE OVER THE ENTIRE AREA PRIOR TO PLACING STONE MEETING THE MIN. SPECIFICATIONS:
  - TENSILE STRENGTH = 200 LBS.
  - PUNCTURE STRENGTH = 80 PSI
  - TEAR STRENGTH = 50 LBS.
  - BURST STRENGTH = 320 PSI
  - ELONGATION = 20%
  - EQUIVALENT OPENING SIZE ≤ 0.6 MM
  - PERMITTIVITY = 0.001 CM/SEC
- APPLY ADDITIONAL STONE AS CONDITIONS DEMAND AND REPLENISH STONE WHEN THE DEPTH IS LESS THAN 6". REMOVE AND REPLACE IF STONES BECOMES MUD-LADEN.
- IMMEDIATELY REMOVE MUD DROPPED, WASHED OR TRACKED ONTO ROADS OR ANY SURFACE WHERE RUNOFF IS NOT CHECKED BY SEDIMENT CONTROLS BY SCRAPING OR SWEEPING.
- CONSTRUCTION ENTRANCES SHALL NOT BE RELIED UPON TO REMOVE MUD FROM VEHICLES OR TO PREVENT OFF-SITE TRACKING. VEHICLES THAT ENTER AND LEAVE THE CONSTRUCTION SITE SHALL BE RESTRICTED FROM MUDDY AREAS.



**CE CONSTRUCTION ENTRANCE**  
SCALE: NONE

**NOTES:**

- THE SEED BED SHALL BE PULVERIZED AND LOOSE TO ENSURE THE SUCCESS OF ESTABLISHING VEGETATION.
- SOIL AMENDMENTS MAY BE REQUIRED TO ESTABLISH ADEQUATE VEGETATION. PERFORM SOIL TESTS ON THE SITE TO PREDICT THE NEED FOR LIME AND FERTILIZER.
- APPLY SEED UNIFORMLY. COVER BROADCAST SEED BY RAKING OR DRAGGING AND THEN LIGHTLY TAMPING INTO PLACE.
- APPLY MULCHING IMMEDIATELY AFTER SEEDING.
- SEEDING SHALL BE INSPECTED FOR BARE SPOTS AND WASHOUTS, AND RESEEDED AS NECESSARY.

TEMPORARY SEEDING SPECIES SELECTION			
DATES	SPECIES	LB/1,000 SF	LB/AC.
MARCH 1 TO AUGUST 15	OATS	3	128
	TALL FESCUE	1	40
	PERENNIAL RYEGRASS	1	40
	PERENNIAL RYEGRASS	2	40
	TALL FESCUE	1	40
AUGUST 16 TO NOVEMBER 1	RYE	3	112
	TALL FESCUE	1	40
	PERENNIAL RYEGRASS	1	40
	WHEAT	3	120
	TALL FESCUE	1	40
	PERENNIAL RYEGRASS	1	40
	PERENNIAL RYEGRASS	2	40
	TALL FESCUE	1	40
NOVEMBER 1 TO SPRING	ONLY MULCH OR DORMANT SEEDING.		


**TEMPORARY SEEDING DETAIL**  
SCALE: NONE

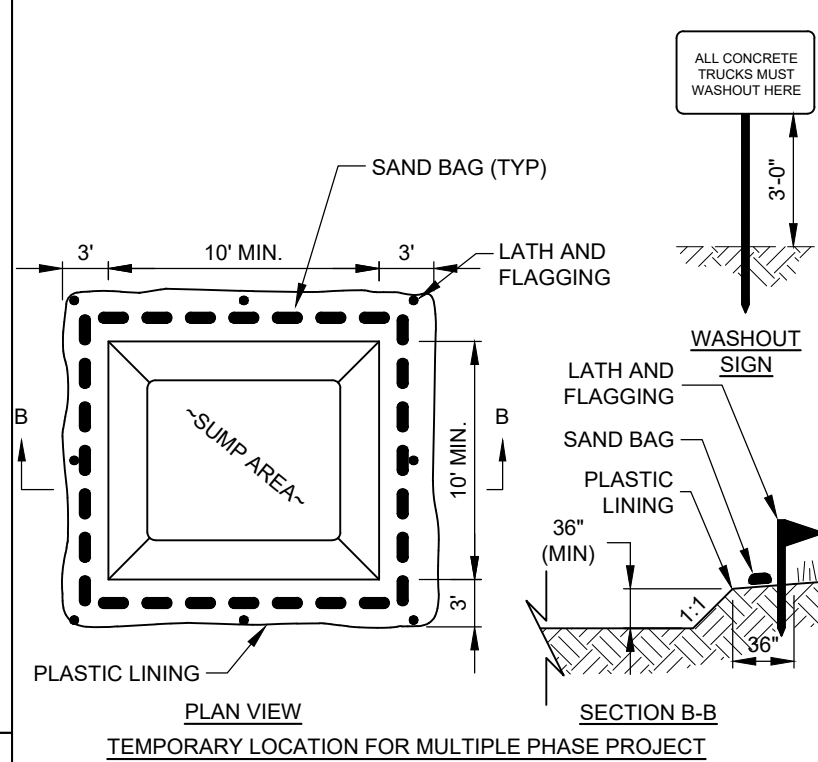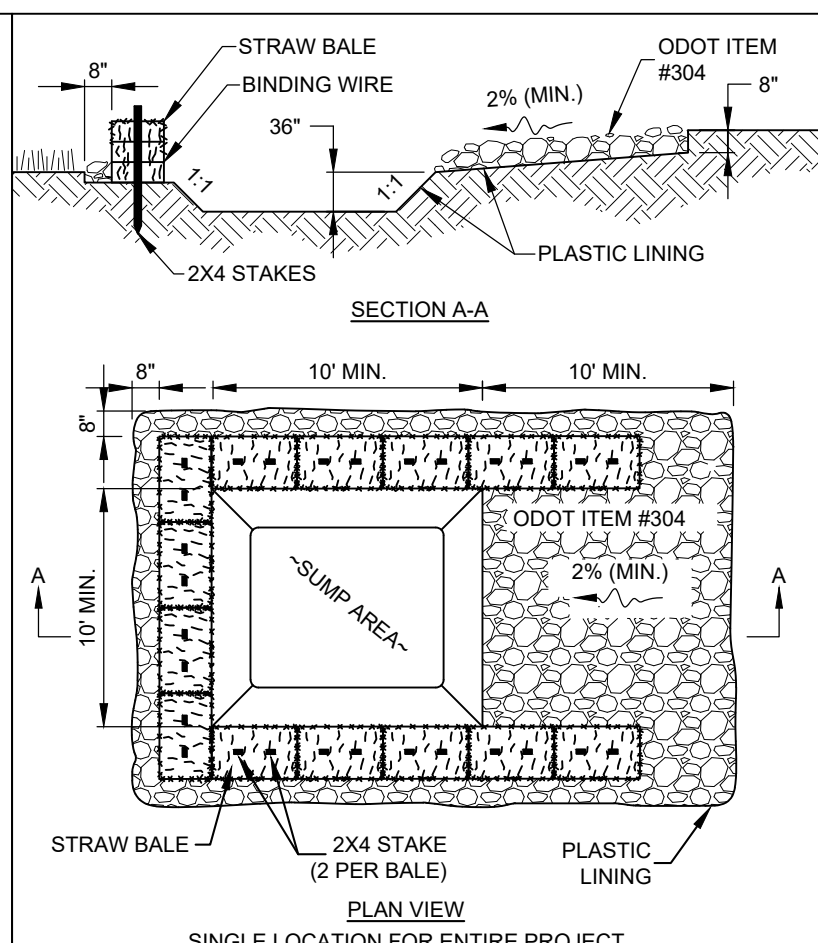

**NOTES:**

- WASHOUT PIT SHALL BE LOCATED 100' MINIMUM FROM INLETS, STREAMS, WETLANDS AND ANY OTHER SURFACE WATERS.
- ALL EXCESS CONCRETE AND CONCRETE WASHOUT, INCLUDING FROM HAND MIXERS AND LIGHT EQUIPMENT, SHALL BE DISPOSED OF IN THE CONCRETE WASHOUT AREA. DISPOSAL OF EXCESS CONCRETE OR CONCRETE WASHOUT ON THE GROUND, OR IN STORM DRAINS, DITCHES OR WATER BODIES, IS PROHIBITED.
- CONCRETE WASHOUT AREA SHALL BE SUFFICIENT SIZE TO CONTAIN CONCRETE WASTE GENERATED. FOR LARGER SITES, MULTIPLE CONCRETE WASHOUT AREAS MAY BE REQUIRED.
- IF CONCRETE WASHOUT AREA IS LOCATED AWAY FROM A PAVED SURFACE, CONSTRUCT A GRAVEL ACCESS ROUTE EQUAL IN COMPOSITION TO THE CONSTRUCTION ENTRANCE.
- PLASTIC LINING SHALL BE DOUBLE-LINED, CONTINUOUS 10-MIL POLYETHYLENE SHEETING FREE OF HOLES, TEARS OR OTHER DEFECTS, AND INSTALLED ON A SMOOTH, LEVEL SURFACE, FREE OF ROCKS OR DEBRIS.
- CONCRETE WASHOUT AREAS SHALL BE COVERED DURING INCLEMENT WEATHER TO PREVENT OVERFLOWS.
- PREFABRICATED, PORTABLE AND RE-USABLE CONCRETE WASHOUT CONTAINERS ARE ACCEPTABLE, BUT MUST BE SPECIFICALLY DESIGNED FOR CONCRETE WASHOUT USE.
- CONCRETE WASHOUT AREA SHALL BE INSPECTED DAILY TO CHECK FOR DAMAGE AND TO DETERMINE IF IT NEEDS CLEANED OR REPLACED. ANY DAMAGE TO THE SIDEWALLS OR POLYETHYLENE SHEETING SHALL BE REPAIRED IMMEDIATELY. THE CONCRETE WASHOUT AREA SHALL BE CLEANED OR REPLACED WHEN IT IS 75% FULL. THE POLYETHYLENE SHEETING SHALL BE REPLACED AFTER EACH CLEANING.
- SAW CUT CONCRETE, RESIDUE FROM SAW CUT, AND GRINDINGS SHALL BE DISPOSED OF IN THE WASHOUT PIT.

**WA CONCRETE WASHOUT DETAIL**  
SCALE: NONE

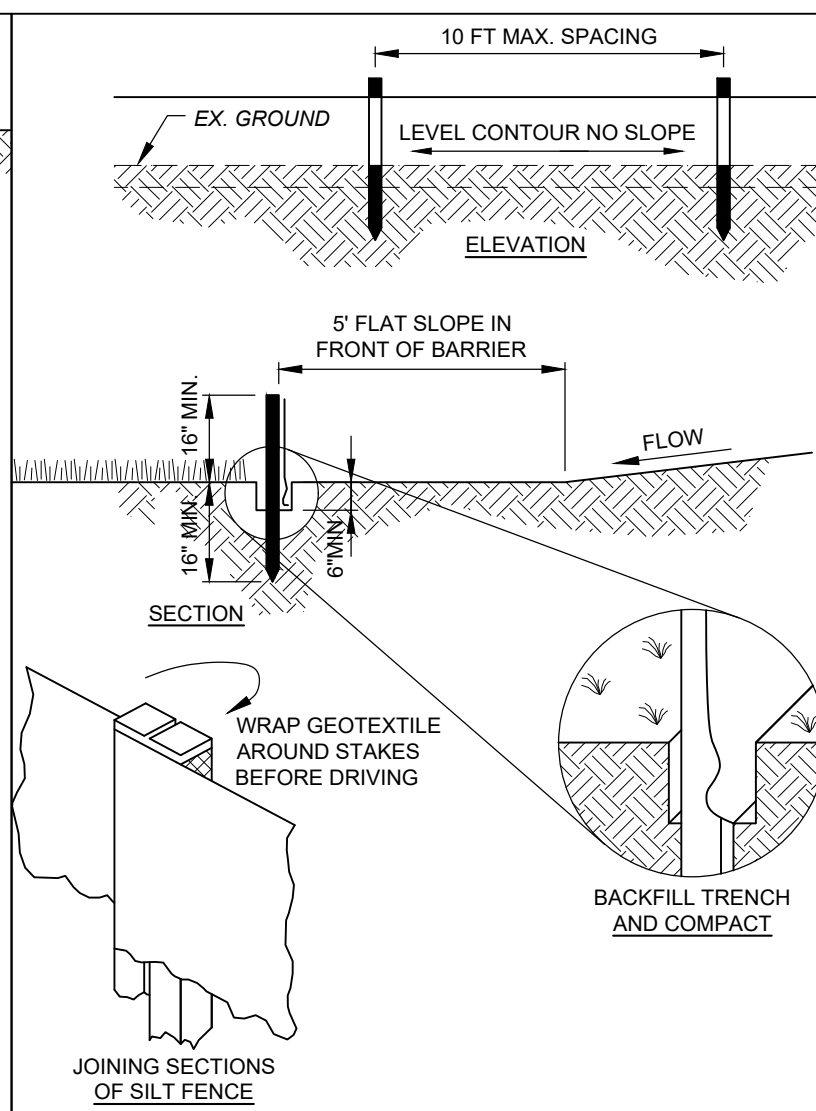


**NOTES:**



- PRESERVE VEGETATION FOR 5 FEET, OR AS MUCH AS POSSIBLE, UPSLOPE FROM THE SILT FENCE. IF VEGETATION IS REMOVED, IT SHALL BE RE-ESTABLISHED WITHIN 7 DAYS FROM SILT FENCE INSTALLATION.
- SILT FENCE SHALL ALLOW RUNOFF TO PASS ONLY AS DIFFUSE FLOW THROUGH THE GEOTEXTILE. PERFORM ONE OF THE FOLLOWING IF RUNOFF OVERTOPS THE SILT FENCE, FLOWS UNDER OR AROUND THE ENDS, OR IN ANY OTHER WAY BECOMES A CONCENTRATED FLOW:
  - CHANGE THE LAYOUT OF THE SILT FENCE.
  - REMOVE ACCUMULATED SEDIMENT.
  - INSTALL OTHER PRACTICES.

FABRIC PROPERTIES	VALUES	TEST METHOD
GRAB TENSILE STRENGTH	90 LB. MIN	ASTM D-1682
MULLEN BURST STRENGTH	190 PSI MIN	ASTM D-3786
SLURRY FLOW RATE	0.3 GAL./MIN./S.F. MAX.	
EQUIVALENT OPENING SIZE	40-80	US STD. SIEVE CW-02215
ULTRAVIOLET RADIATION STABILITY	90% MIN	ASTM-G-26


**SF SILT FENCE**  
SCALE: NONE

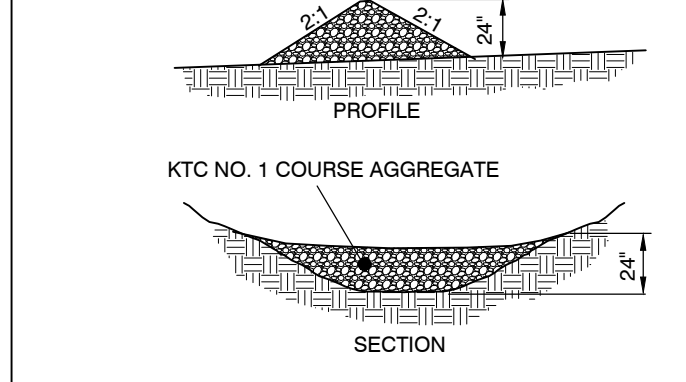

**CD CHECK DAM**  
N.T.S.

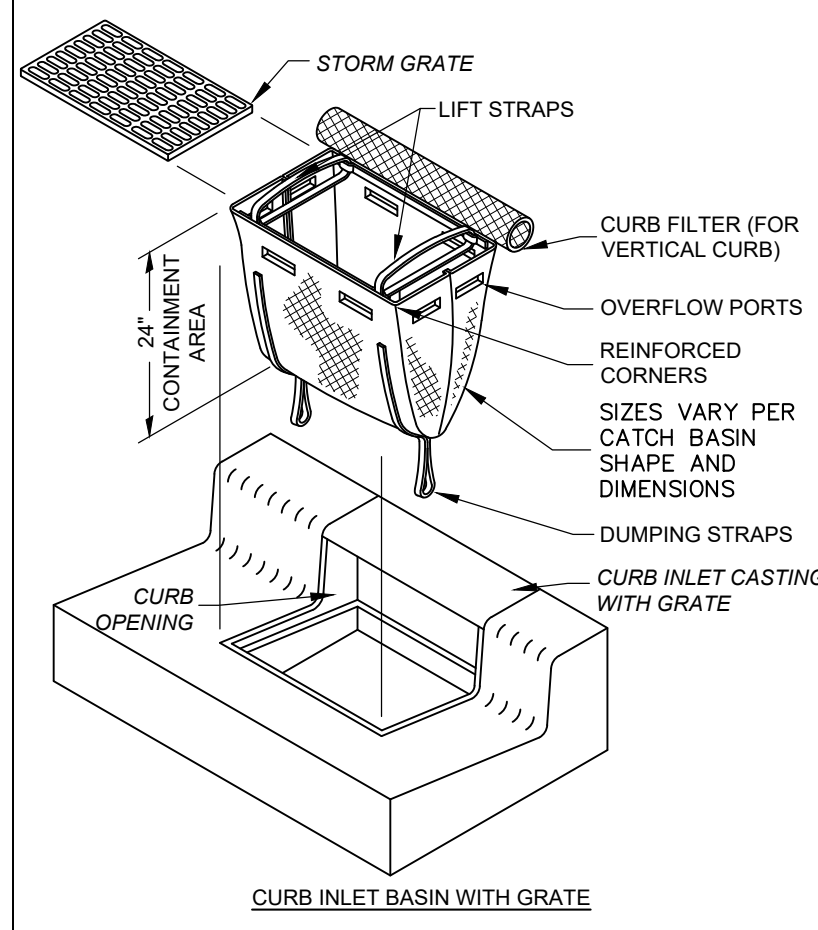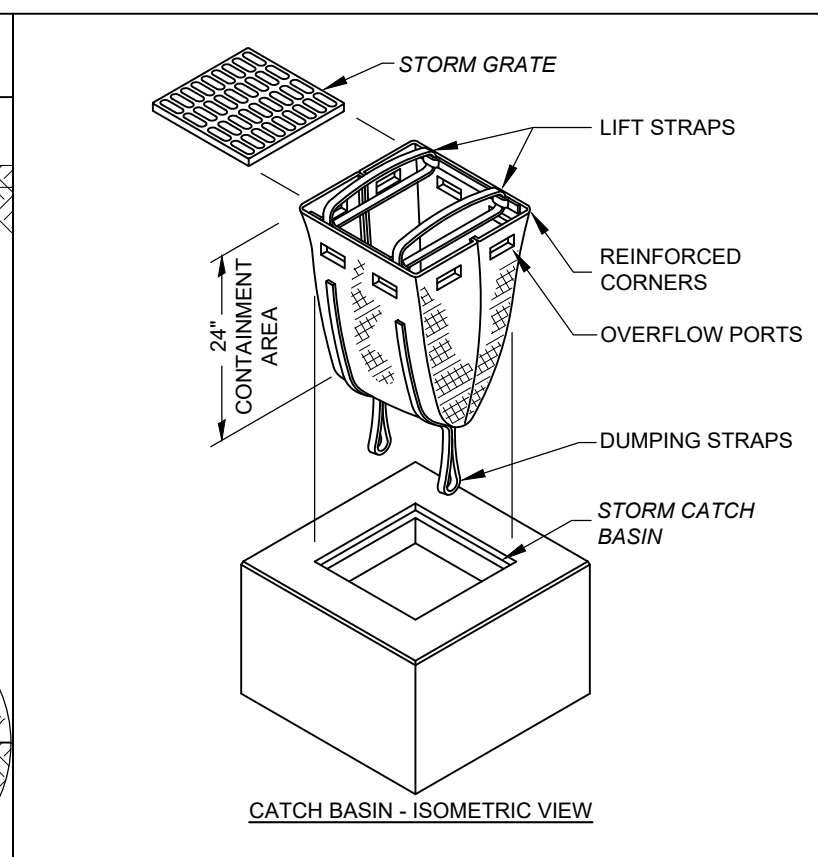

**IP STORM DRAIN INLET PROTECTION DETAIL**  
SCALE: NONE

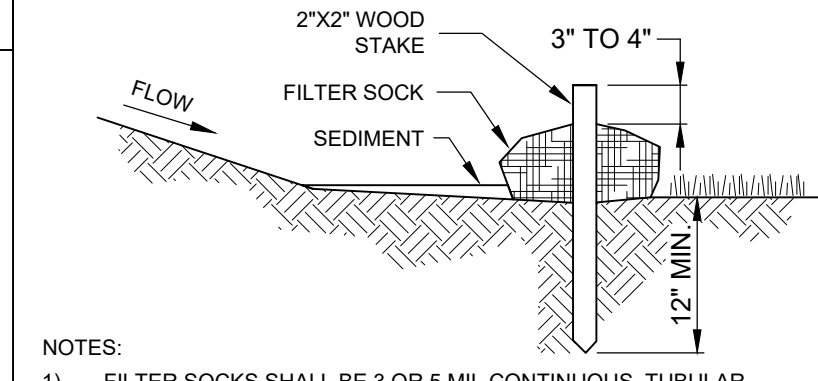


**NOTES:**

- FILTER SOCKS SHALL BE 3 OR 5 MIL CONTINUOUS, TUBULAR, HDPE 3/8" KNITTED MESH NETTING MATERIAL, FILLED WITH COMPOST.
- COMPOST SHALL BE WEED, PATHOGEN AND INSECT FREE, FREE OF ANY REFUSE, CONTAMINANTS OR OTHER MATERIALS TOXIC TO PLANT GROWTH, BE DERIVED FROM A WELL-DECOMPOSED SOURCE OF ORGANIC MATTER, AND CONSIST OF PARTICLES RANGING FROM 3/8" TO 2".
- FILTER SOCKS SHALL BE PLACED ON A LEVEL LINE ACROSS SLOPES PARALLEL TO THE BASE OF THE SLOPE.
- FILTER SOCKS SHALL BE PLACED AT LEAST 5' FROM THE TOE OF SLOPE FOR SEDIMENT DEPOSIT.
- BUILT UP SEDIMENT SHALL BE REMOVED WHEN IT HAS REACHED 1/3 THE FILTER SOCK HEIGHT.
- WHEN A FILTER SOCK IS NO LONGER REQUIRED, IT SHALL BE DISPERSED ON-SITE.
- THE MAXIMUM DRAINAGE AREA PER 100 FEET OF FILTER SOCK IS 1/2 ACRE AND IS DEPENDENT ON THE SLOPE:

MAX. SLOPE LENGTH ABOVE FILTER SOCK					
SLOPE	RATIO (H:V)	8'	12'	18'	24'
0% - 2%	0 - 50:1	125'	250'	300'	350'
2% - 10%	50:1 - 10:1	100'	125'	200'	250'
10% - 20%	10:1 - 5:1	75'	100'	150'	200'

**FILTER SOCK DETAIL**  
SCALE: NONE

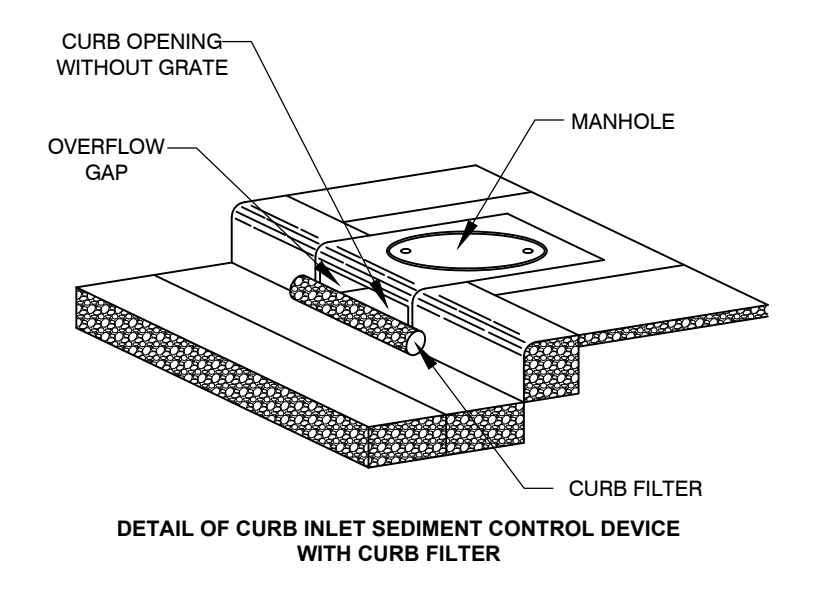

**IP DANDY CURB**  
SCALE: NONE



300 BUTTERNUT PIKE, SUITE 332  
FORT MITCHELL, KENTUCKY 41017  
TEL: (859) 525-0644  
WWW.VERDANTAS.COM

ISSUED FOR:	ISSUE DATE:	SCALE:	DESIGNED BY:	DRAWN BY:	CHECKED BY:
BIDDING	05/28/2026	1"=10'	DGAR	DGAR	MHEL

**115 KENNEDY PLAYGROUND  
SITE GRADING  
CITY OF FORT WRIGHT  
KENTON COUNTY, KY**

PROJECT NO.	
39397	
DISCIPLINE	
CIVIL	
SHEET NAME	
C04	
SHEET	OF
7	7