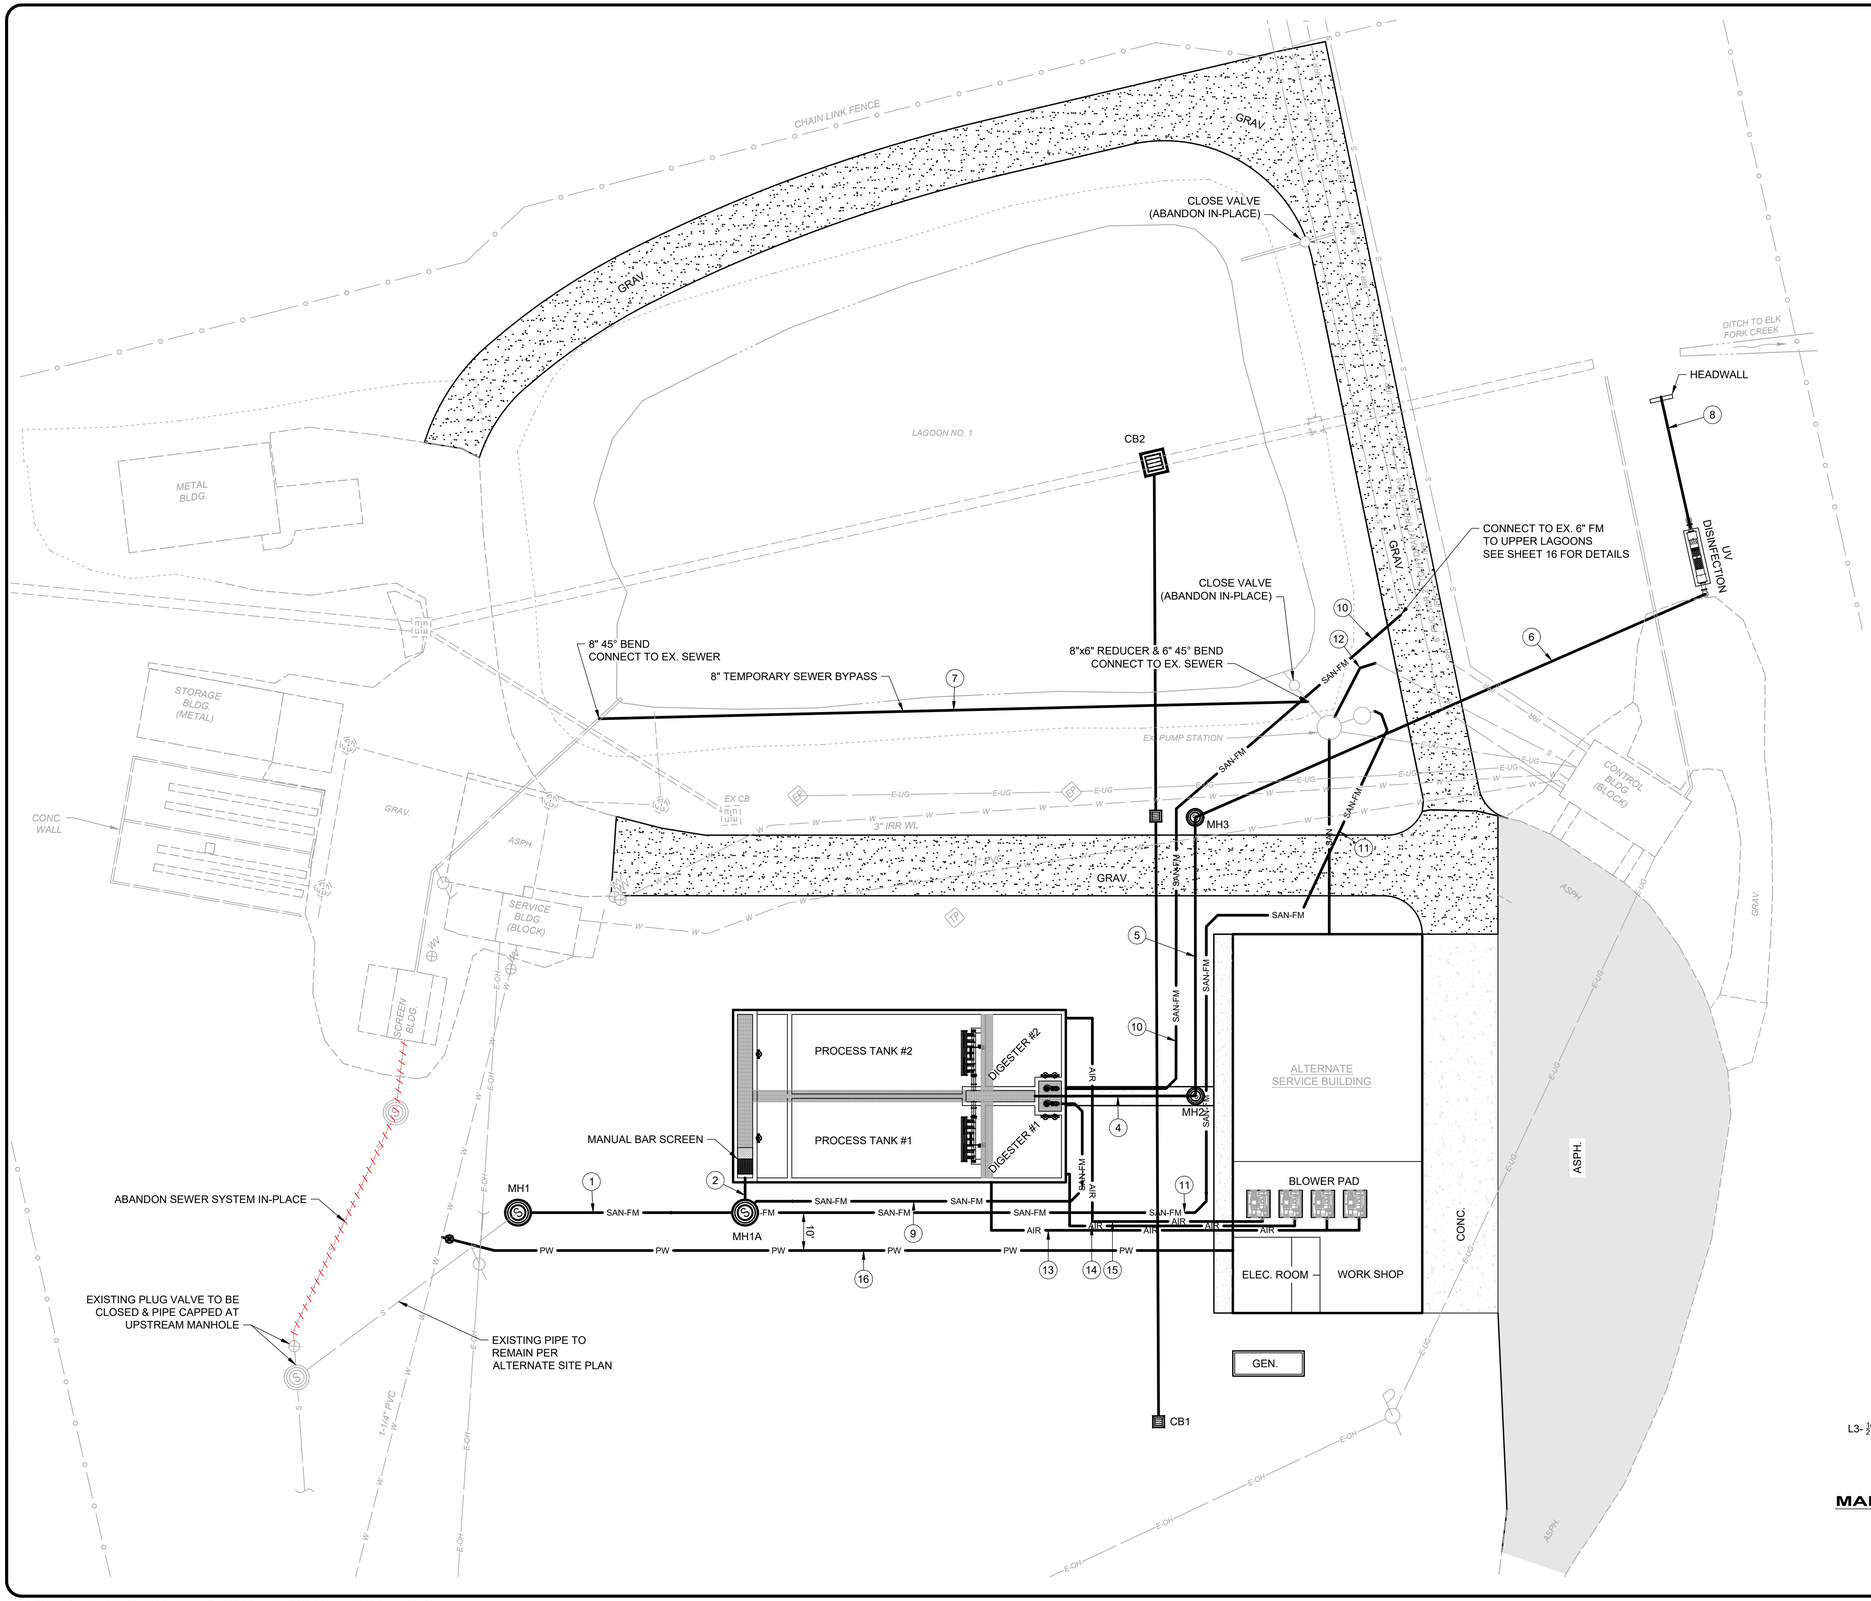


20 ' 0 ' 20 '


SCALE: 1" = 20 '

PIPE LEGEND


1. 12" PVC SDR 35, MH1 TO MH1A - 60'
2. 12" PVC SDR 35, MH1 TO SCREEN CHANNEL - 10'
3. ~~8" PVC SDR 35, MH1 TO EX. PIPE - 10'~~
4. 18" PVC SDR 35, EFF. CHANNEL TO MH2 - 34'
5. 18" PVC SDR 35, MH2 TO MH3 - 74'
6. 18" PVC SDR 35, MH3 TO UV - 148'
7. 8" PVC SDR 35, EX. SWR. TO EX. PS - 187'
8. 24" PVC SDR 35, UV TO HEADWALL OUTFALL - 37'
9. 6" PVC SDR 21, SUPERNATANT RETURN LINE - 120'
10. 6" PVC SDR 21, DIGESTED SLUDGE LINE - 180'
11. 4" PVC SDR 21, EX. PS TO MH1 - 282'
12. 4" PVC SDR 35, EX. CTRL. BLDG. SAN - 19'
13. 8" DIP, AIR PIPING FROM BLOWERS TO SBR TANK - 80'
14. 6" DIP, AIR PIPING TO DIGESTER #1 - 60'
15. 6" DIP, AIR PIPING TO DIGESTER #2 - 100'
16. 1-1/4" HDPE C901 DR 13.5, WATER LINE - 210'

NOTES:

1. ALL PIPING DISTANCES ARE APPROXIMATIONS.
2. SEE SHEET 8 FOR EXISTING SITE PIPING.
3. SEE SHEET 12 FOR GRADING PLAN AND STORM PIPING.
4. SEE SHEET XX FOR ELECTRICAL SITE PLAN.



FRONT VIEW

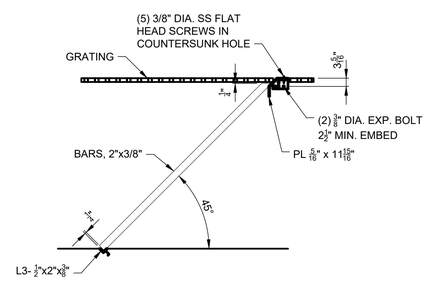

SECTION VIEW

MANUAL BAR SCREEN - ALTERNATE

NOT TO SCALE

ALTERNATE 1

BID SET

verdantas

NO	REVISION	DATE
1	ADDENDUM #4	10/01/2026

ISSUED FOR:	BIDDING
ISSUE DATE:	7/20/2026
SCALE:	AS NOTED
DESIGNED BY:	KAB
DRAWN BY:	AGD
CHECKED BY:	KAB

ADAMS COUNTY
NORTH ADAMS REGIONAL WASTEWATER TREATMENT PLANT
WINCHESTER, OHIO
ADAMS COUNTY

SITE IMPROVEMENTS - 01 SERIES

PROPOSED SITE PIPING PLAN - ALTERNATE

PROJECT NO.
200619
DISCIPLINE
CIVIL
SHEET NAME
01C-06A
SHEET 11A OF 79

C:\CTC\CADI_DRIVES_H\2020\200619\DWG\SHEETS\C_200619 - PROPOSED SITE PIPING PLAN-ALTERNATE.DWG - 01C-06A - 10/1/2026 7:38:55 AM - ADAM DAWSON