



To: All Plan Holders of Record

From: Verdantas LLC
For the Owner

Re: Addendum No. 2
Wastewater Treatment Plant Clarifier Improvements – Phase 1
Village of Jefferson

Date: March 5, 2025

This Addendum forms a part of the contract documents and modifies the original bidding documents dated February 2025 and all previous addenda, if any. Acknowledge receipt of this addendum in the space provided in the bid forms. Failure to do so may subject the bidder to disqualification.

QUESTIONS AND ANSWERS

Q1. Are the local control panels for each clarifier mechanism being replaced.

A1. Yes, refer to Image #4 on Sheet 15. Also refer to Specification 464321 for control panel specifications.

Q2. Is the Aluminum cover plate near Clarifier No. 3's walkway being replaced.

A2. Yes, see attached drawing SK-1. The new access hatch must be leak proof. Contractor to submit options for the Village to approve.

PLANS

On plan sheet 15/15 **CHANGE** Demo Note 2. to the following:

2. DISCONNECT EXISTING SLUDGE COLLECTOR DRIVE SYSTEM LOCAL CONTROL STATION. TO BE REPLACED AND CONNECTED BY THE CONTRACTOR.

SPECIFICATIONS


In Specification Section 464321, **ADD** the following to section 2.1 after part A. 1.:

2. Or Approved Equal.


GC/MB:mep

Enclosures

H:\2024\241530\SPEC\Addenda\Addendum 02\Addendum 02.Doc

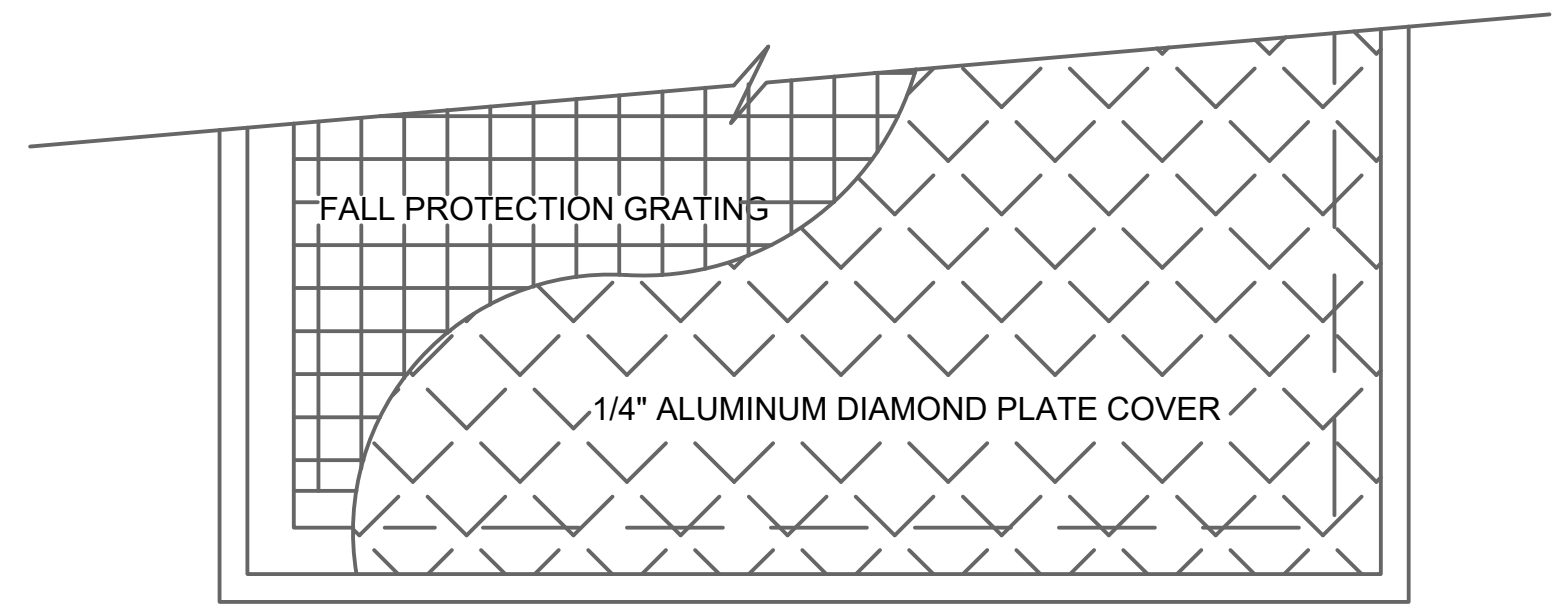


PARTIAL PLAN

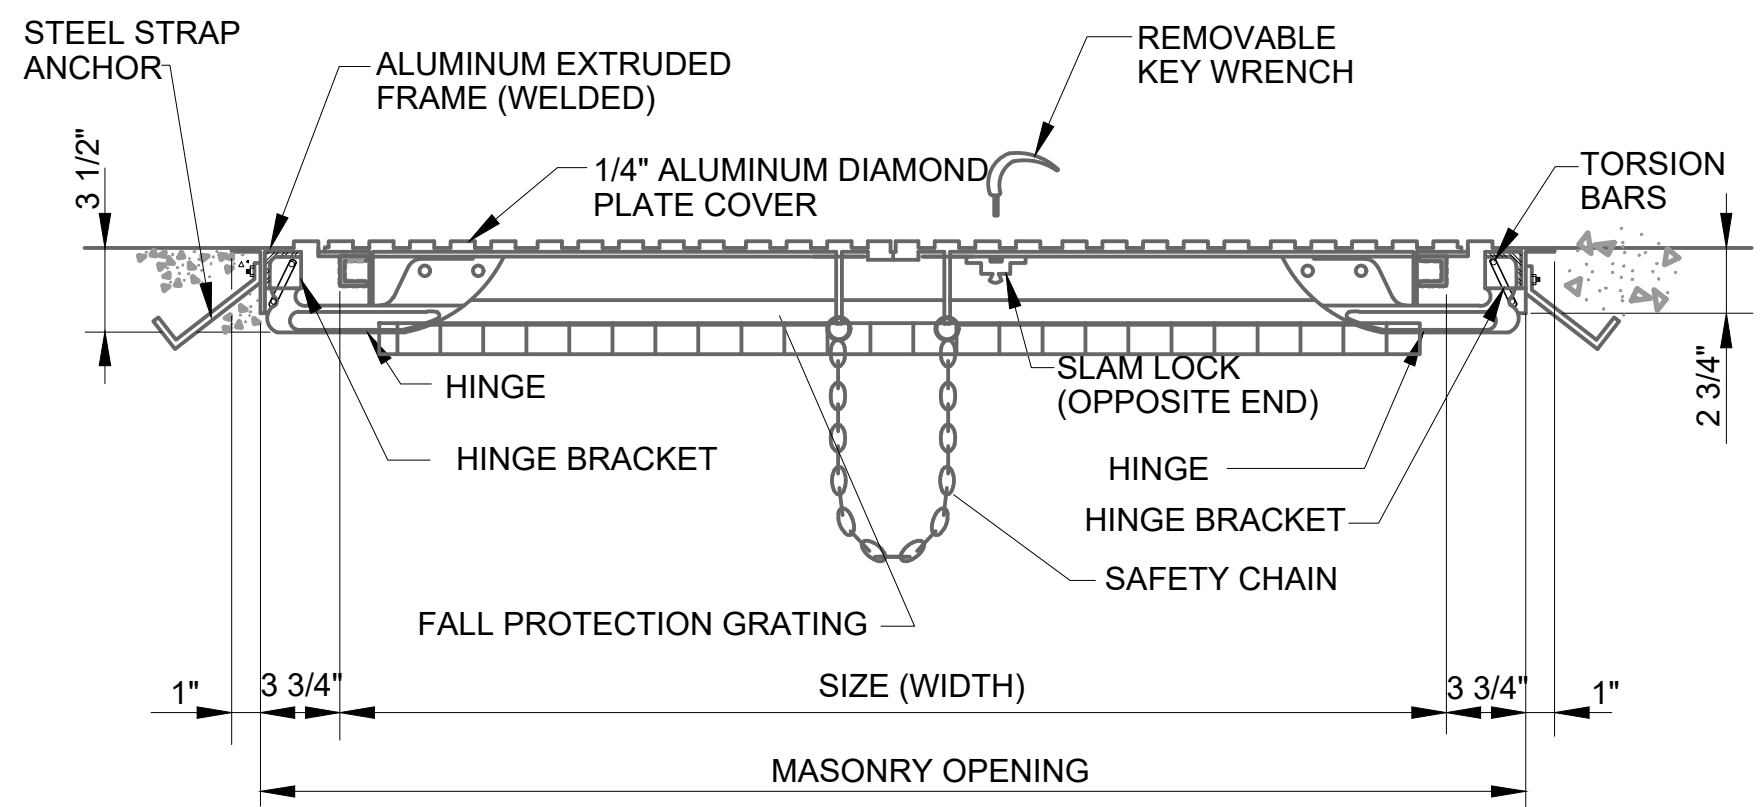

TYPE "KD"

(DOUBLE LEAF ALUMINUM)

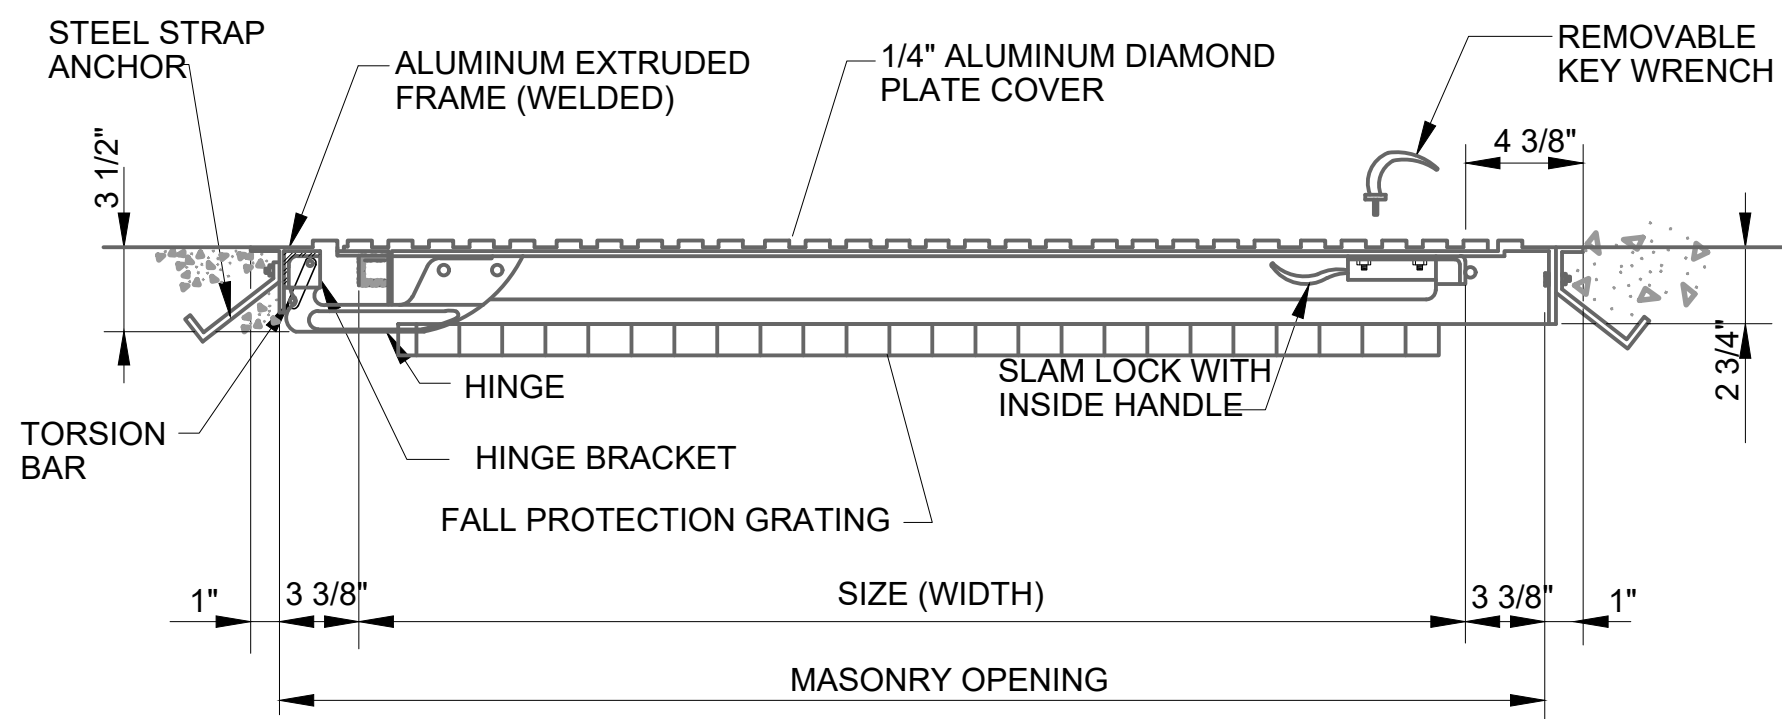

TYPE "K"

(SINGLE LEAF ALUMINUM)

FLOOR ACCESS DOOR TYPES

N.T.S. SD-7-21

NOTE: THIS DRAWING SHALL BE CONSIDERED TO BE PART OF SHEET 12 OF 15.

ENGINEER'S PROJECT NO. 241530	VILLAGE OF JEFFERSON, OH	DATE	SCALE	ADDENDUM	DRAWING
	JEFFERSON WASTEWATER TREATMENT PLANT CLARIFIER IMPROVEMENTS - PHASE1	3/5/2025	N.T.S	# 2	SK-1